



VRV IV+ heat pump,
with continuous
heating
Air Conditioning
Technical Data
RYYQ-U



TABLE OF CONTENTS

RYYQ-U

1	Features	4
	RYYQ-U	4
2	Specifications	5
3	Options	17
4	Combination table	18
5	Capacity tables	21
	Capacity Table Legend	21
	Capacity Correction Factor	22
6	Dimensional drawings	35
7	Centre of gravity	36
8	Piping diagrams	37
9	Wiring diagrams	39
	Wiring Diagrams - Three Phase	39
10	External connection diagrams	42
11	Sound data	44
	Sound Power Spectrum	44
	Sound Pressure Spectrum	48
	Sound Pressure Spectrum Quiet Mode Level 1	52
	Sound Pressure Spectrum Quiet Mode Level 2	54
	Sound Pressure Spectrum Quiet Mode Level 3	56
12	Installation	58
	Installation Method	58
	Fixation and Foundation of Units	59
	Refrigerant Pipe Selection	60
13	Operation range	62
14	Appropriate Indoors	63

1 Features

1 - 1 RYYQ-U

Daikin's optimum solution with top comfort

1

- › By choosing this product with LOOP by Daikin you support the reuse of refrigerant
- › Covers all thermal needs of a building via a single point of contact: accurate temperature control, ventilation, hot water, air handling units and Biddle air curtains
- › Wide range of indoor units: possibility to combine VRV with stylish indoor units (Daikin Emura, Perfera)
- › Incorporates VRV standards & technologies: Variable Refrigerant Temperature, continuous heating, VRV configurator, 7 segment display and full inverter compressors, 4-side heat exchanger, refrigerant cooled PCB, new DC fan motor
- › Customize your VRV for best seasonal efficiency & comfort with the weather dependant Variable Refrigerant Temperature function. Increased seasonal efficiency with up to 28%. No more cold draft by supply of high outblow temperatures
- › Continuous comfort: Unique continuous heating technology makes VRV IV the best alternative to traditional heating systems
- › Free combination of outdoor units to meet installation space or efficiency requirements
- › ESP up to 78.4 Pa allows ducting
- › Simplified installation & guaranteed optimal efficiency with automatic charging & testing
- › Easy compliance with F-gas regulation thanks to automated refrigerant containment check
- › Wide piping flexibility: 30m indoor height difference, maximum piping length: 190m, total piping length: 1,000m
- › The ability to control each conditioned zone individually keeps VRV system running costs to an absolute minimum
- › Spread your installation cost by phased installation
- › Keep your system in top condition via the Daikin Cloud Service: 24/7 monitoring for maximum efficiency, extended lifetime and immediate service support thanks to failure prediction
- › Available as heating only by irreversible field setting



Inverter



Variable refrigerant temperature

2 Specifications

2 - 1 Specifications

Technical Specifications				RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U	RYYQ16U	RYYQ18U	RYYQ20U
Recommended combination				4 x FXFQ50AVEB	4 x FXFQ63BVEB	6 x FXFQ50BVEB	1 x FXFQ50BVEB + 5 x FXFQ63BVEB	4 x FXFQ63BVEB + 2 x FXFQ80BVEB	3 x FXFQ50BVEB + 5 x FXFQ63BVEB	2 x FXFQ50BVEB + 6 x FXFQ63BVEB
Recommended combination 2				4 x FXSQ50A2VEB	4 x FXSQ63A2VEB	6 x FXSQ50A2VEB	1 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	3 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	2 x FXSQ50A2VEB + 6 x FXSQ63A2VEB
Recommended combination 3				4 x FXMQ50P7VEB	4 x FXMQ63P7VEB9	6 x FXMQ50P7VEB9	1 x FXMQ50P7VEB9 + 5 x FXMQ63P7VEB9	4 x FXMQ63P7VEB9 + 2 x FXMQ80P7VEB9	3 x FXMQ50P7VEB9 + 5 x FXMQ63P7VEB9	2 x FXMQ50P7VEB9 + 6 x FXMQ63P7VEB9
Continuous heating				Yes						
Cooling capacity		Prated,c	kW	22.4 (1)	28.0 (1)	33.5 (1)	40.0 (1)	45.0 (1)	50.4 (1)	52.0 (1)
Heating capacity		Nom. 6°CWB	kW	22.4 (2)	28.0 (2)	33.5 (2)	40.0 (2)	45.0 (2)	50.4 (2)	56.0 (2)
		Prated,h	kW	22.4 (2)	28.0 (2)	33.5 (2)	40.0 (2)	45.0 (2)	50.4 (2)	56.0 (2)
		Max. 6°CWB	kW	25.0 (2)	31.5 (2)	37.5 (2)	45.0 (2)	50.0 (2)	56.5 (2)	63.0 (2)
COP at nom. capacity		kW/kW	kW/kW/ KW/KW	4.15 (2)	3.69 (2)	3.47 (2)	3.74 (2)	3.59 (2)	3.54 (2)	3.2 (2)
ESEER - Automatic				7.53	7.2	6.96	6.83	6.5	6.38	5.67
ESEER - Standard				6.37	5.67	5.5	5.31	5.05	4.97	4.42
SCOP				4.3	4.1	4.0	4.0	4.2	4.0	4.0
SCOP recommended combination 2				4.2	4.3	4.1	4.0	4.1	4.2	4.0
SCOP recommended combination 3				4.2	4.1	4.0	4.0	4.1	4.1	3.9
SEER				7.6	6.8	6.3	6.0	6.0	5.9	5.9
SEER recommended combination 2				6.9	6.8	5.9	6.3	5.9	6.0	5.9
SEER recommended combination 3				7.5	6.8	6.2	5.8	6.0	6.0	5.9
ηs,c		%		302.4	267.6	247.8	250.7	236.5	238.3	233.7
ηs,c recommended combination 2		%		-	270.5	233.5	250.0	234.2	236.8	233.9
ηs,c recommended combination 3		%		-	267.1	246.3	246.7	230.4	238.2	233.1
ηs,h		%		167.9	168.2	161.4	155.4	157.8	163.1	156.6
ηs,h recommended combination 2		%		-	170.6	161.3	157.2	159.5	164.8	158.2
ηs,h recommended combination 3		%		-	162.0	160.6	155.7	156.8	159.6	153.4
Space cooling				A Condition EERd (35°C - 27/19) Pdc	3.0	2.3	2.4	2.6	2.1	1.9
		kW		22.4	28.0	33.5	40.0	45.0	50.4	52.0
		B Condition EERd (30°C - 27/19) Pdc	kW	5.2	4.7	4.3	4.1	3.9	3.8	3.7
		C Condition EERd (25°C - 27/19) Pdc	kW	9.5	8.3	7.7	7.8	7.7	7.5	7.3
		D Condition EERd (20°C - 27/19) Pdc	kW	10.6	13.3	15.9	18.9	21.3	23.9	24.6
				18.8	17.0	13.9	14.3	14.2	18.3	
				8.0	9.3	9.4	8.4	9.5	11.5	
Space cooling recommended combination 2				A Condition EERd (35°C - 27/19) Pdc	2.6	2.4	2.6	2.1	1.9	
		kW		22.4	28.0	33.5	40.0	45.0	50.4	52.0
		B Condition EERd (30°C - 27/19) Pdc	kW	4.9	4.7	4.0	4.1	3.8	3.7	3.6
		C Condition EERd (25°C - 27/19) Pdc	kW	16.5	20.6	24.7	29.5	33.2	37.1	38.3
				8.8	8.5	7.1	7.9	7.6	7.5	7.3
Space cooling recommended combination 3				C Condition EERd (25°C - 27/19) Pdc	10.6	13.3	15.9	18.9	21.3	23.9
		kW		10.6	13.3	15.9	18.9	21.3	23.9	24.6
		D Condition EERd (20°C - 27/19) Pdc	kW	15.1	17.2	13.1	14.0	14.2	18.1	18.9
				8.8	9.3	9.1	8.4	9.5	11.4	10.9
Space cooling recommended combination 3				A Condition EERd (35°C - 27/19) Pdc	3.0	2.3	2.4	2.6	2.1	1.9
		kW		22.4	28.0	33.5	40.0	45.0	50.4	52.0
		B Condition EERd (30°C - 27/19) Pdc	kW	5.1	4.7	4.2	4.0	3.7	3.7	3.6
		C Condition EERd (25°C - 27/19) Pdc	kW	16.5	20.6	24.7	29.5	33.2	37.1	38.3
				9.6	8.4	7.7	7.4	7.6	7.6	7.3
		D Condition EERd (20°C - 27/19) Pdc	kW	10.6	13.3	15.9	19.0	21.3	23.9	24.6
				16.0	16.9	13.7	14.0	14.1	18.3	
				9.1	9.3	9.4	8.4	9.5	11.6	
Space heating (Average climate)				TBivalent COPd (declared COP)	2.5	2.4	2.0	2.3	2.2	1.9
		Pdh (declared heating cap)	kW	13.7	16.0	18.4	20.6	23.2	27.9	31.0
		Tbiv (bivalent temperature)	°C	-10						
TOL				COPd (declared COP)	2.5	-	-	-	-	-
		Pdh (declared heating cap)	kW	13.7	-	-	-	-	-	-
		Tol (temperature operating limit)	°C	-10						
		A Condition COPd (declared COP) (-7°C)	kW	2.7	2.6	2.4	2.6	2.4	2.1	2.1
		Pdh (declared heating cap)	kW	12.1	14.2	16.3	18.2	20.5	24.7	27.4
		B Condition COPd (declared COP) (2°C)	kW	3.9	3.5	3.1	3.5	3.7	3.6	3.6
		Pdh (declared heating cap)	kW	7.4	8.6	9.9	11.1	12.5	15.0	16.7
		C Condition COPd (declared COP) (7°C)	kW	6.3	6.4	6.1	6.3	6.7	6.5	6.5
		Pdh (declared heating cap)	kW	5.0	5.5	6.4	7.1	8.0	9.7	10.7
		D Condition COPd (declared COP) (12°C)	kW	7.9	8.2	7.9	8.5	8.6	9.0	9.1
		Pdh (declared heating cap)	kW	5.9	6.3	6.3	4.9	7.1	7.1	7.1

2 Specifications

2 - 1 Specifications

Technical Specifications					RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U	RYYQ16U	RYYQ18U	RYYQ20U	
Space heating (Average climate) recommended combination 2	A Condition (-7°C)	COPd (declared COP)			2.7		2.4	2.6		2.4	2.2	
		Pdh (declared heating cap)		kW	12.1	14.2	16.3	18.2	20.5	24.7	27.4	
	B Condition (2°C)	COPd (declared COP)			3.9	4.0	3.9	3.5		3.8	3.7	
		Pdh (declared heating cap)		kW	7.4	8.6	9.9	11.1	12.2	15.0	16.7	
	C Condition (7°C)	COPd (declared COP)			6.3	6.5	6.1		6.3	6.8	6.5	
		Pdh (declared heating cap)		kW	5.0	5.5	6.4	7.1	8.0	9.7	10.7	
	D Condition (12°C)	COPd (declared COP)			7.8	8.3	7.9	8.6	8.7	9.1	9.2	
		Pdh (declared heating cap)		kW	5.9	6.0	6.4	4.9	5.0	7.2		
	TBivalent	COPd (declared COP)			2.4		1.9	2.3	2.2	1.9	1.8	
		Pdh (declared heating cap)		kW	13.7	16.0	18.4	20.6	23.2	27.9	31.0	
Tbiv (bivalent temperature)		°C	-10									
TOL	COPd (declared COP)			2.4		1.9	2.3	2.2	1.9	1.8		
	Pdh (declared heating cap)			13.7	16.0	18.4	20.6	23.2	27.9	31.0		
	Tol (temperature operating limit)		°C	-10								
Space heating (Average climate) recommended combination 2	TOL	Pdh (declared heating cap)			13.7	16.0	18.4	20.6	23.2	27.9	31.0	
Space heating (Average climate) recommended combination 3	A Condition (-7°C)	COPd (declared COP)			2.7	2.6	2.4	2.6		2.4	2.1	
		Pdh (declared heating cap)		kW	12.1	14.2	16.3	18.2	20.5	24.7	27.4	
	B Condition (2°C)	COPd (declared COP)			3.9	3.7	3.9	3.5		3.7	3.6	
		Pdh (declared heating cap)		kW	7.4	8.6	9.9	11.1	12.5	15.0	16.7	
	C Condition (7°C)	COPd (declared COP)			6.2	6.4	6.0	6.1	6.2	6.5	6.3	
		Pdh (declared heating cap)		kW	4.9	5.5	6.4	7.1	8.0	9.7	10.7	
	D Condition (12°C)	COPd (declared COP)			7.8	8.1	7.8	8.5	8.6	8.7		
		Pdh (declared heating cap)		kW	5.8	5.9	6.2	4.9		6.9		
	TBivalent	COPd (declared COP)			2.5	2.4	2.0	2.3	2.2	1.9	1.8	
		Pdh (declared heating cap)		kW	13.7	16.0	18.4	20.6	23.2	27.9	31.0	
		Tbiv (bivalent temperature)		°C	-10							
	TOL	COPd (declared COP)			2.5	2.4	2.0	2.3	2.2	1.9	1.8	
		Pdh (declared heating cap)		kW	13.7	16.0	18.4	20.6	23.2	27.9	31.0	
		Tol (temperature operating limit)		°C	-10							
	Capacity range	HP			8	10	12	14	16	18	20	
PED	Category				Category II							
	Most critical part	Name			Accumulator							
					325			415		493		
Maximum number of connectable indoor units					64 (3)							
Indoor index connection	Min.				100.0	125.0	150.0	175.0	200.0	225.0	250.0	
	Max.				260.0	325.0	390.0	455.0	520.0	585.0	650.0	
Dimensions	Unit	Height			mm							
		Width			mm							
		Depth			mm							
	Packed unit	Height			mm							
		Width			mm							
		Depth			mm							
Weight	Unit			252	242		338		374			
	Packed unit			265	257		355		391			
Packing	Material				Carton							
	Weight				1.8			2.2				
Packing 2	Material				Wood							
	Weight				11.0	12.8		14.0				
Packing 3	Material				Plastic							
	Weight				0.5			0.6				
Casing	Colour				Daikin White							
	Material				Painted galvanized steel plate							
Heat exchanger	Type				Cross fin coil							
	Indoor side				Air							
	Outdoor side				-							
	Air flow rate	Cooling	Rated	m³/h	9,720	10,500	11,100	13,380	15,600	15,060	15,660	
Fan	Heating				Rated	m³/h	9,720	10,500	11,100	13,380	15,600	15,060
	Quantity				1			2				
Fan motor	External static pressure	Max.	Pa			78						
	Quantity				1			2				
Compressor	Type				DC motor		DC Motor					
	Output	W			550			750				
Operation range	Quantity				1			2				
	Type				Hermetically sealed scroll compressor							
Sound power level	Crankcase heater				W	33	-					
	Cooling	Min.	°CDB			-5.0						
		Max.	°CDB			43.0						
	Heating	Min.	°CWB			-20.0						
Max.		°CWB			15.5							
Sound power level	Cooling	Nom.	dBA			78.0 (4)	79.1 (4)	83.4 (4)	80.9 (4)	85.6 (4)	83.8 (4)	87.9 (4)
	Heating	Prated,h	dBA			79.6 (4)	80.9 (4)	83.5 (4)	83.1 (4)	86.5 (4)	85.3 (4)	89.8 (4)

2 Specifications

2 - 1 Specifications

Technical Specifications					RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U	RYYQ16U	RYYQ18U	RYYQ20U	
Sound pressure level	Cooling	Nom.		dB(A)	57.0 (5)		61.0 (5)	60.0 (5)	63.0 (5)	62.0 (5)	65.0 (5)	
Refrigerant	Type				R-410A							
	GWP				2,087.5							
	Charge		TCO2Eq		12.3	-						
	Charge		kg		5.9	6.0	6.3	10.3	10.4	11.7	11.8	
	Charge		tCO2Eq		-	12.5	13.2	21.5	21.7	24.4	24.6	
Refrigerant oil	Type				Synthetic (ether) oil FVC68D							
Piping connections	Liquid	Type				Braze connection						
		OD		mm	9.52		12.7			15.9		
	Gas	Type				Braze connection						
		OD		mm	19.1	22.2	28.6					
	Total piping length	System	Actual		m	1,000 (6)						
Defrost method					Reversed cycle							
Capacity control	Method				Inverter controlled							
Indication if the heater is equipped with a supplementary heater					no	No						
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0							
Power consumption in other than active mode	Crankcase heater mode	Cooling	PCK	kW	0.000	0.0			0.0			
		Heating	PCK	kW	0.052			0.077		0.089		
	Off mode	Cooling	POFF	kW	0.041			0.074		0.075		
		Heating	POFF	kW	0.052			0.077		0.089		
	Standby mode	Cooling	PSB	kW	0.041			0.074		0.075		
		Heating	PSB	kW	0.052			0.077		0.089		
	Thermo-stat-off mode	Cooling	PTO	kW	0.005			0.01			0.01	
		Heating	PTO	kW	0.056			0.097		0.098		
Cooling	Cdc (Degradation cooling)				0.25							
Heating	Cdh (Degradation heating)				0.25							
Safety devices	Item	01				High pressure switch						
		02				Fan driver overload protector						
		03				Inverter overload protector						
		04				PC board fuse						
		05				Leakage current detector						

Standard accessories: Installation manual;Quantity: 1;

Standard accessories: Operation manual;Quantity: 1;

Standard accessories: Connection pipes;Quantity: 1;

Electrical Specifications				RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U	RYYQ16U	RYYQ18U	RYYQ20U
Power supply	Name			Y1						
	Phase			3N~						
	Frequency Hz			50						
	Voltage V			380-415						
Power supply intake				Both indoor and outdoor unit						
Voltage range	Min. %			-10						
	Max. %			10						
Current	Nominal running current (RLA)	Cooling	A	7.2 (7)	-					
Current - 50Hz	Nominal running current (RLA)	Combina-tion A	Cooling	-						
		Combina-tion B	Cooling	-						
	Starting current (MSC) - remark			See note 8	See note 7					
	Zmax	List			No requirements					
	Minimum Ssc value kVa/kVA			4,050 (8)	5,535 (8)	6,038 (8)	6,793 (8)	7,547 (8)	8,805 (8)	9,812 (8)
	Minimum circuit amps (MCA) A			16.1 (9)	22.0 (9)	24.0 (9)	27.0 (9)	31.0 (9)	35.0 (9)	39.0 (9)
	Maximum fuse amps (MFA) A			20 (10)	25 (10)	32 (10)		40 (10)		50 (10)
	Full load amps (FLA)	Total	A	1.2 (11)	1.3 (11)	1.5 (11)	1.8 (11)	2.6 (11)		
	Power Performance	Power factor	Combina-tion B	35°C ISO - Full load	-					
46°C ISO - Full load				-						
Wiring connections - 50Hz	For power supply	Quantity		5G						
	For connec-tion with indoor	Quantity		2						
		Remark		F1,F2						
Compressor	Crankcase heater		W	33	-					

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m |

(3)Actual number of connectable indoor units depends on the indoor unit type (VRV indoor, Hydrobox, RA indoor, etc.) and the connection ratio restriction for the system (50% ≤ CR ≤ 130%) |

2 Specifications

2 - 1 Specifications

(4) Sound power level is an absolute value that a sound source generates. |

(5) Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings. |

(6) Refer to refrigerant pipe selection or installation manual |

(7) RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB |

(8) In accordance with EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with $S_{sc} \geq$ minimum S_{sc} value |

(9) MCA must be used to select the correct field wiring size. The MCA can be regarded as the maximum running current. |

(10) MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker). |

(11) FLA means the nominal running current of the fan |

MSC means the maximum current during start up of the compressor. This unit uses only inverter compressors. Starting current is always $\leq$ max. running current. |

Maximum allowable voltage range variation between phases is 2%. |

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

The AUTOMATIC ESEER value corresponds with normal VRV4 Heat Pump operation, taking into account advanced energy saving operation functionality (variable refrigerant temperature) |

The STANDARD ESEER value corresponds with normal VRV4 Heat Pump operation, not taking into account advanced energy saving operation functionality |

Sound values are measured in a semi-anechoic room. |

Sound pressure system [dBA] = $10 \cdot \log[10^A(A/10) + 10^B(B/10) + 10^C(C/10)]$, with Unit A = A dBA, Unit B = B dBA, Unit C = C dBA |

EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current $> 16A$ and $\leq 75A$ per phase |

S_{sc} : Short-circuit power |

For detailed contents of standard accessories, see installation/operation manual |

Multi combination (22~54HP) data is corresponding with the standard multi combination

Technical specifications System			RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U	RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U
System	Outdoor unit module 1		RYMQ10U	RYMQ8U	RYMQ12U			RYMQ16U			RYMQ8U	RYMQ10U
	Outdoor unit module 2		RYMQ12U	RYMQ16U	RYMQ14U	RYMQ16U	RYMQ18U	RYMQ16U	RYMQ18U	RYMQ20U	RYMQ10U	RYMQ12U
	Outdoor unit module 3										RYMQ20U	RYMQ18U
Recommended combination			6 x FXFQ50AVEB + 4 x FXFQ63AVEB	4 x FXFQ50AVEB + 4 x FXFQ63AVEB + 2 x FXFQ80AVEB	7 x FXFQ50AVEB + 5 x FXFQ63AVEB	6 x FXFQ50AVEB + 4 x FXFQ63AVEB + 2 x FXFQ80AVEB	9 x FXFQ50AVEB + 5 x FXFQ63AVEB	8 x FXFQ63AVEB + 4 x FXFQ80AVEB	3 x FXFQ50AVEB + 9 x FXFQ63AVEB + 2 x FXFQ80AVEB	2 x FXFQ50AVEB + 10 x FXFQ63AVEB + 2 x FXFQ80AVEB	6 x FXFQ50AVEB + 10 x FXFQ63AVEB	9 x FXFQ50AVEB + 9 x FXFQ63AVEB
Recommended combination 2			6 x FXSQ50A2VEB + 4 x FXSQ63A2VEB	4 x FXSQ50A2VEB + 4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	7 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	6 x FXSQ50A2VEB + 4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	9 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	8 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	3 x FXSQ50A2VEB + 9 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	2 x FXSQ50A2VEB + 10 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	6 x FXSQ50A2VEB + 10 x FXSQ63A2VEB	9 x FXSQ50A2VEB + 9 x FXSQ63A2VEB
Recommended combination 3			6 x FXMQ50P7VEB + 4 x FXMQ63P7VEB	4 x FXMQ50P7VEB + 4 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	7 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	6 x FXMQ50P7VEB + 4 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	9 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	8 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	3 x FXMQ50P7VEB + 9 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	2 x FXMQ50P7VEB + 10 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	6 x FXMQ50P7VEB + 10 x FXMQ63P7VEB	9 x FXMQ50P7VEB + 9 x FXMQ63P7VEB
Continuous heating			Yes									
Cooling capacity	Prated,c	kW	61.5 (1)	67.4 (1)	73.5 (1)	78.5 (1)	83.9 (1)	90.0 (1)	95.4 (1)	97.0 (1)	102.4 (1)	111.9 (1)
Heating capacity	Nom.	6°CWB	61.5 (2)	67.4 (2)	73.5 (2)	78.5 (2)	83.9 (2)	90.0 (2)	95.4 (2)	101.0 (2)	106.4 (2)	111.9 (2)
	Prated,h	kW	61.5 (2)	67.4 (2)	73.5 (2)	78.5 (2)	83.9 (2)	90.0 (2)	95.4 (2)	101.0 (2)	106.4 (2)	111.9 (2)
	Max.	6°CWB	69.0 (2)	75.0 (2)	82.5 (2)	87.5 (2)	94.0 (2)	100.0 (2)	106.5 (2)	113.0 (2)	119.5 (2)	125.5 (2)
COP at nom. capacity	kW/kW	KW/KW/ kW/kW	3.57 (2)	3.76 (2)	3.61 (2)	3.54 (2)	3.51 (2)	3.59 (2)	3.56 (2)	3.36 (2)	3.49 (2)	3.56 (2)
ESEER - Automatic			7.07	6.81	6.89	6.69	6.6	6.5	6.44	6.02	6.36	6.74
ESEER - Standard			5.58	5.42	5.39	5.23	5.17	5.05	5.01	4.68	5.03	5.29
SCOP			4.4	4.3	4.2	4.3	4.2	4.2	4.1	4.3	4.3	4.4
SCOP recommended combination 2			4.4	4.3	4.2	4.3	4.2	4.2	4.2	4.2	4.3	4.4
SCOP recommended combination 3			4.3	4.2	4.2	4.3	4.1	4.2	4.1	4.2	4.2	4.3
SEER			6.9	6.8	6.7	6.5	6.4	6.3	6.3	6.3	6.9	6.7
SEER recommended combination 2			6.7	6.6	6.5	6.3	6.3	6.3	6.3	6.3	6.8	6.6
SEER recommended combination 3			6.9	6.7	6.6	6.4	6.5	6.2	6.3	6.3	6.9	6.7
$\eta_{s,c}$		%	274.5	269.9	264.2	257.8	256.8	251.7	253.3	250.8	272.4	263.5
$\eta_{s,c}$ recommended combination 2		%	266.5	262.6	256.1	249.3	249.8	248.3	250.9	-	-	-
$\eta_{s,c}$ recommended combination 3		%	273.3	265.3	261.1	253.1	256.1	244.2	249.8	-	-	-
$\eta_{s,h}$		%	171.2	167.0	164.6	166.0	169.8	163.1	166.2	162.4	167.5	170.0
$\eta_{s,h}$ recommended combination 2		%	172.3	167.1	165.4	166.8	170.6	164.6	167.7	-	-	-
$\eta_{s,h}$ recommended combination 3		%	170.2	165.5	164.5	165.0	167.0	161.9	164.2	-	-	-
Space cooling	A Condition	EERd	2.6	2.5	2.6	2.3	2.1	2.3	2.1	2.4	2.2	2.2
	(35°C - 27/19) Pdc	kW	61.5	67.4	73.5	78.5	83.9	90.0	95.4	97.0	102.4	111.9
	B Condition	EERd	4.8	4.6	4.4	4.3	4.3	4.2	4.1	4.1	4.5	4.5
	(30°C - 27/19) Pdc	kW	45.3	49.7	54.2	57.8	61.8	66.3	70.3	71.5	75.5	82.5
	C Condition	EERd	8.5	8.6	8.2	8.1	8.2	8.1	7.9	7.9	8.5	8.3
	(25°C - 27/19) Pdc	kW	29.1	31.9	34.8	37.2	39.7	42.6	45.2	45.9	48.5	53.0
	D Condition	EERd	16.0	15.2	14.2	14.3	16.8	14.3	16.8	16.7	17.9	16.0
	(20°C - 27/19) Pdc	kW	18.8	15.8	16.2	16.5	21.0	19.0	20.1	20.4	21.6	23.6
	A Condition	EERd	2.6	2.4	2.6	2.3	2.1	2.2	2.1	2.3	2.2	2.2
	(35°C - 27/19) Pdc	kW	61.5	67.4	73.5	78.5	83.9	90.0	95.4	97.0	102.4	111.9
Space cooling recommended combination 2	B Condition	EERd	4.6	4.5	4.4	4.3	4.2	4.1	4.1	4.1	4.5	4.4
	(30°C - 27/19) Pdc	kW	45.3	49.7	54.1	57.8	61.8	66.3	70.3	71.5	75.4	82.4
	C Condition	EERd	8.2	8.4	7.9	7.8	7.9	8.0	8.1	7.9	8.4	8.1
	(25°C - 27/19) Pdc	kW	29.1	31.9	34.8	37.2	39.7	42.6	45.2	45.9	48.5	53.0
	D Condition	EERd	15.6	14.7	13.6	13.8	16.1	14.0	16.5	17.8	15.9	15.9
	(20°C - 27/19) Pdc	kW	18.4	15.4	15.7	16.5	20.5	18.9	20.1	20.4	21.6	23.6

2 Specifications

2 - 1 Specifications

Technical specifications System					RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U	RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U
Space cooling recommended combination 3	A Condition (35°C - 27/19) Pdc	EERd			2.5			2.3	2.1	2.2	2.1		2.4	2.2
			kW		61.5	67.4	73.5	78.5	83.9	90.0	95.4	97.0	102.4	111.9
	B Condition (30°C - 27/19) Pdc	EERd			4.8	4.5		4.3		4.1		4.0	4.5	4.4
			kW		45.3	49.7	54.2	57.8	61.8	66.3	70.3	71.5	75.5	82.5
	C Condition (25°C - 27/19) Pdc	EERd			8.5	8.4	8.1	8.0	8.2	7.8	8.0	7.8	8.5	8.4
Space heating (Average climate)	D Condition (20°C - 27/19) Pdc	EERd			29.1	31.9	34.8	37.2	39.7	42.6	45.2	45.9	48.5	53.0
			kW		15.8	15.2	14.0	14.1	16.6	13.8	16.6	16.5	17.9	16.1
			kW		18.8	15.7	16.0	16.6	21.0	19.0	20.1	20.4	21.6	23.6
	TBivalent	COPd (declared COP)			2.3	2.5	2.3	2.2	2.1	2.4	2.2	2.1		2.2
		Pdh (declared heating cap)	kW		34.4	36.9	39.0	41.6	46.3	46.4	51.1	54.2	60.7	62.3
Space heating (Average climate) recommended combination 2	Tbiv (bivalent temperature)	°C			-10									
	TOL	COPd (declared COP)			-									
		Pdh (declared heating cap)	kW		-									
		Tol (temperature operating limit)	°C		-10									
	A Condition (-7°C) Pdh (declared heating cap)		kW		2.6	2.8		2.6		2.7	2.6	2.5		2.6
Space heating (Average climate) recommended combination 2	B Condition (2°C) Pdh (declared heating cap)		kW		30.4	32.6	34.5	36.8	41.0		45.2	47.9	53.7	55.1
			kW		4.0	3.7		3.8	3.9	3.6		3.7	3.9	4.0
	C Condition (7°C) Pdh (declared heating cap)		kW		18.5	19.9	21.0	22.4	24.9	25.0	27.5	29.2	32.7	33.5
			kW		6.3		6.1	6.2	6.5	6.3	6.5	6.4		6.5
	D Condition (12°C) Pdh (declared heating cap)		kW		11.9	13.0	13.5	14.4	16.0	16.1	17.7	18.8	21.3	21.6
Space heating (Average climate) recommended combination 2			kW		8.2	8.9	8.8		9.0		8.8	8.6		8.7
			kW		6.0	5.7	6.0	6.4	7.1		7.9	8.3		13.1
	A Condition (-7°C) Pdh (declared heating cap)		kW		2.6	2.7		2.6		2.7	2.6	2.5		2.6
			kW		30.4	32.6	34.5	36.8	41.0		45.2	47.9	53.7	55.1
	B Condition (2°C) Pdh (declared heating cap)		kW		4.1	3.7		3.8	3.9	3.6	3.8	3.7	3.9	4.0
Space heating (Average climate) recommended combination 2			kW		18.5	19.9	21.0	22.4	24.9	25.0	27.5	29.2	32.7	33.5
	C Condition (7°C) Pdh (declared heating cap)		kW		6.3		6.1	6.3	6.6	6.3	6.6		6.5	
			kW		11.9	13.1		14.4	16.0	16.1	17.7	18.8	21.3	21.6
	D Condition (12°C) Pdh (declared heating cap)		kW		8.4	9.0	8.9		9.1		8.9		8.8	
			kW		6.0	5.7	6.0	6.4	7.2	7.1	7.9	8.3		13.2
Space heating (Average climate) recommended combination 2	TBivalent	COPd (declared COP)			2.2	2.4	2.2		2.1	2.4	2.2		2.3	2.2
		Pdh (declared heating cap)	kW		34.4	36.9	39.0	41.6	46.3	46.4	51.1	54.2	60.7	62.3
	Tbiv (bivalent temperature)	°C			-10									
	TOL	COPd (declared COP)			2.2	2.4	2.2		2.1	2.4	2.2		2.3	2.2
		Pdh (declared heating cap)	kW		34.4	36.9	39.0	41.6	46.3	46.4	51.1	54.2	60.7	62.3
Space heating (Average climate) recommended combination 3		Tol (temperature operating limit)	°C		-10									
	A Condition (-7°C) Pdh (declared heating cap)		kW		2.6	2.7		2.6	2.5	2.7	2.6	2.4	2.5	2.6
			kW		30.4	32.6	34.5	36.8	41.0		45.2	47.9	53.7	55.1
	B Condition (2°C) Pdh (declared heating cap)		kW		4.0	3.7		3.8	3.9	3.6	3.7	3.6	3.8	3.9
	C Condition (7°C) Pdh (declared heating cap)		kW		18.5	19.9	21.0	22.4	24.9	25.0	27.5	29.2	32.7	33.5
Capacity range			kW		6.2	6.3	6.1	6.2	6.3		6.4	6.3		6.4
			kW		11.9	12.9	13.5	14.4	16.0	16.1	17.7	18.8	21.2	21.6
	D Condition (12°C) Pdh (declared heating cap)		kW		8.2	8.9	8.8	9.0	8.6	9.0	8.9	8.3	8.5	8.4
			kW		6.0	5.7	6.0	6.4	7.1		7.9	8.3	12.9	12.8
	TBivalent	COPd (declared COP)			2.3	2.4	2.2		2.1	2.4	2.2	2.1		2.2
Indoor index connection		Pdh (declared heating cap)	kW		34.4	36.9	39.0	41.6	46.3	46.4	51.1	54.2	60.7	62.3
		Tbiv (bivalent temperature)	°C		-10									
	TOL	COPd (declared COP)			2.3	2.4	2.2		2.1	2.4	2.2	2.1		2.2
		Pdh (declared heating cap)	kW		34.4	36.9	39.0	41.6	46.3	46.4	51.1	54.2	60.7	62.3
		Tol (temperature operating limit)	°C		-10									
Capacity range	HP				22	24	26	28	30	32	34	36	38	40
PED	Category				Category II									
Maximum number of connectable indoor units					64 (3)									
Indoor index connection	Min.				275.0	300.0	325.0	350.0	375.0	400.0	425.0	450.0	475.0	500.0
	Max.				715.0	780.0	845.0	910.0	975.0	1,040.0	1,105.0	1,170.0	1,235.0	1,300.0
Heat exchanger	Indoor side				Air									
	Outdoor side				Air									
Air flow rate	Cooling	Rated	m³/h		21,600	25,320	24,480	26,700	26,160	31,200	30,660	31,260	35,880	36,660
	Heating	Rated	m³/h		21,600	25,320	24,480	26,700	26,160	31,200	30,660	31,260	35,880	36,660
Sound power level	Cooling	Nom.	dBA		84.8 (4)	86.3 (4)	85.3 (4)	87.6 (4)	86.6 (4)	88.6 (4)	87.8 (4)	89.9 (4)	88.8 (4)	87.3 (4)
	Heating	Prated,h	dBA		85.4 (4)	87.3 (4)	86.3 (4)	88.3 (4)	87.5 (4)	89.5 (4)	88.9 (4)	91.5 (4)	90.7 (4)	88.4 (4)
Sound pressure level	Cooling	Nom.	dBA		62.5 (5)	64.0 (5)	63.5 (5)	65.1 (5)	64.5 (5)	66.0 (5)	65.5 (5)	67.1 (5)	66.2 (5)	65.2 (5)
Refrigerant	Type				R-410A									
	GWP				2,087.5									
Refrigerant oil	Type				Synthetic (ether) oil FVC68D									
Piping connections	Liquid	Type			Brazed connection									
	OD	mm			15.9					19.1				
Piping connections	Gas	Type			Brazed connection									
	OD	mm			28.6			34.9					41.3	
Total piping length	System	Actual	m		1,000 (6)									
Indication if the heater is equipped with a supplementary heater					No									

2 Specifications

2 - 1 Specifications

Technical specifications System					RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U	RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0									
Power consumption in other than active mode	Crankcase heater mode	Cooling	PCK	kW	0.0							0.000		
		Heating	PCK	kW	0.103	0.129			0.141	0.154	0.166		0.192	
	Off mode	Cooling	POFF	kW	0.081	0.115			0.116	0.149	0.15	0.150	0.157	
		Heating	POFF	kW	0.103	0.129			0.141	0.154	0.166		0.192	
	Standby mode	Cooling	PSB	kW	0.081	0.115			0.116	0.149	0.15	0.150	0.157	
		Heating	PSB	kW	0.103	0.129			0.141	0.154	0.166		0.192	
	Thermo-stat-off mode	Cooling	PTO	kW	0.009	0.014				0.019				
		Heating	PTO	kW	0.113	0.154			0.155	0.195	0.196		0.211	
Cooling	Cdc (Degradation cooling)			0.25										
Heating	Cdh (Degradation heating)			0.25										

Technical specifications System					RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U	RYYQ52U	RYYQ54U
System	Outdoor unit module 1				RYMQ10U	RYMQ12U	RYMQ14U	RYMQ16U			RYMQ18U
	Outdoor unit module 2				RYMQ16U						RYMQ18U
	Outdoor unit module 3				RYMQ16U						RYMQ18U
Recommended combination					12 x FXFQ63AVEB + 4 x FXFQ80AVEB	6 x FXFQ50AVEB + 8 x FXFQ63AVEB + 4 x FXFQ80AVEB	1 x FXFQ50AVEB + 13 x FXFQ63AVEB + 4 x FXFQ80AVEB	12 x FXFQ63AVEB + 6 x FXFQ80AVEB	3 x FXFQ50AVEB + 13 x FXFQ63AVEB + 4 x FXFQ80AVEB	6 x FXFQ50AVEB + 14 x FXFQ63AVEB + 2 x FXFQ80AVEB	9 x FXFQ50AVEB + 15 x FXFQ63AVEB
Recommended combination 2					12 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	6 x FXSQ50A2VEB + 8 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	1 x FXSQ50A2VEB + 13 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	12 x FXSQ63A2VEB + 6 x FXSQ80A2VEB	3 x FXSQ50A2VEB + 13 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	6 x FXSQ50A2VEB + 14 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	9 x FXSQ50A2VEB + 15 x FXSQ63A2VEB
Recommended combination 3					12 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	6 x FXMQ50P7VEB + 8 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	1 x FXMQ50P7VEB + 13 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	12 x FXMQ63P7VEB + 6 x FXMQ80P7VEB	3 x FXMQ50P7VEB + 13 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	6 x FXMQ50P7VEB + 14 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	9 x FXMQ50P7VEB + 15 x FXMQ63P7VEB
Continuous heating					Yes						
Cooling capacity	Prated,c		kW		118.0 (1)	123.5 (1)	130.0 (1)	135.0 (1)	140.4 (1)	145.8 (1)	151.2 (1)
Heating capacity	Nom.	6°CWB	kW		118.0 (2)	123.5 (2)	130.0 (2)	135.0 (2)	140.4 (2)	145.8 (2)	151.2 (2)
	Prated,h		kW		118.0 (2)	123.5 (2)	130.0 (2)	135.0 (2)	140.4 (2)	145.8 (2)	151.2 (2)
	Max.	6°CWB	kW		131.5 (2)	137.5 (2)	145.0 (2)	150.0 (2)	156.5 (2)	163.0 (2)	169.5 (2)
COP at nom. capacity	6°CWB		kW/kW		3.61 (2)	3.56 (2)	3.63 (2)	3.59 (2)	3.57 (2)	3.56 (2)	3.54 (2)
ESEER - Automatic					6.65	6.62	6.60	6.50	6.46	6.42	6.38
ESEER - Standard					5.19	5.17	5.13	5.05	5.02	4.99	4.97
SCOP					4.2		4.1		4.2		4.3
SCOP recommended combination 2					4.3		4.2				4.3
SCOP recommended combination 3					4.2		4.1		4.2		
SEER					6.6	6.5	6.4				
SEER recommended combination 2					6.6	6.3	6.4	6.3		6.4	
SEER recommended combination 3					6.5	6.3		6.2	6.3	6.4	
ηs,c			%		261.2	255.9	254.9	251.7	252.8	253.7	254.1
ηs,h			%		165.5	164.5	162.0	162.8	165.2	167.2	169.4
Space cooling	A Condition (35°C - 27/19)	EERd			2.3		2.4	2.3	2.1	2.0	1.9
	Pdc		kW		118.0	123.5	130.0	135.0	140.4	145.8	151.2
	B Condition (30°C - 27/19)	EERd			4.4			4.3	4.2		4.1
	Pdc		kW		86.9	91.0	95.8	99.5	103.4	107.4	111.4
	C Condition (25°C - 27/19)	EERd			8.2	8.1					
	Pdc		kW		55.9	58.5	61.6	64.0	66.5	69.1	71.6
	D Condition (20°C - 27/19)	EERd			15.4	14.4	14.3		15.9	17.6	19.1
	Pdc		kW		24.8	26.0	27.4	28.4	29.6	30.7	34.4
Space cooling recom- mended combination 2	A Condition (35°C - 27/19)	EERd			2.3		2.2		2.1	2.0	1.9
	Pdc		kW		118.0	123.5	130.0	135.0	140.4	145.8	151.2
	B Condition (30°C - 27/19)	EERd			4.4	4.3		4.2		4.1	
	Pdc		kW		86.9	91.0	95.8	99.5	103.5	107.4	111.4
	C Condition (25°C - 27/19)	EERd			8.2	7.9	8.1	8.0		8.1	
Space cooling recom- mended combination 3	Pdc		kW		55.9	58.5	61.6	63.9	66.5	69.0	71.6
	D Condition (20°C - 27/19)	EERd			15.3		14.0	15.6		17.4	18.9
	Pdc		kW		24.8	26.0	27.4	28.4	29.6	30.7	34.1
	A Condition (35°C - 27/19)	EERd			2.3		2.2		2.1	2.0	1.9
	Pdc		kW		118.0	123.5	130.0	135.0	140.4	145.8	151.2
Space cooling recom- mended combination 2	B Condition (30°C - 27/19)	EERd			4.3		4.2		4.1		
	Pdc		kW		87.0	91.0	95.8	99.5	103.5	107.4	111.4
	C Condition (25°C - 27/19)	EERd			8.0	7.9		7.8	7.9	8.0	8.2
	Pdc		kW		55.9	58.5	61.6	63.9	66.5	69.1	71.6
	D Condition (20°C - 27/19)	EERd			15.2	14.2	13.9	13.8	15.6	17.5	19.1
	Pdc		kW		24.8	26.0	27.4	28.4	29.6	30.7	34.7

2 Specifications

2 - 1 Specifications

Technical specifications System					RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U	RYYQ52U	RYYQ54U	
Space heating (Average climate)	TBivalent	COPd (declared COP)			2.4	2.3	2.4		2.3	2.2	2.1	
		Pdh (declared heating cap)			kW	62.4	64.8	67.0	69.6	74.3	79.0	83.7
		Tbiv (bivalent temperature)			°C	-10						
	TOL	COPd (declared COP)			2.4	2.3	2.4		2.3	2.2	2.1	
		Pdh (declared heating cap)			kW	62.4	64.8	67.0	69.6	74.3	79.0	83.7
		Tol (temperature operating limit)			°C	-10						
	A Condition (-7°C)	COPd (declared COP)			2.7					2.6		
	Pdh (declared heating cap)			kW	55.2	57.3	59.3	61.6	65.7	69.9	74.0	
	B Condition (2°C)	COPd (declared COP)			3.7		3.6		3.7	3.8	3.9	
	Pdh (declared heating cap)			kW	33.6	34.9	36.1	37.5	40.0	42.5	45.1	
	C Condition (7°C)	COPd (declared COP)			6.3		6.2	6.3	6.5	6.6	6.8	
	Pdh (declared heating cap)			kW	21.6	22.4	23.2	24.1	25.7	27.4	29.0	
	D Condition (12°C)	COPd (declared COP)			8.6		8.7	8.8	8.9	9.0		
	Pdh (declared heating cap)			kW	9.9	10.0	10.3	10.7	12.0	14.2		
Space heating (Average climate) recommended combination 2	A Condition (-7°C)	COPd (declared COP)			2.7					2.6		
	Pdh (declared heating cap)			kW	55.2	57.3	59.3	61.6	65.7	69.9	74.0	
	B Condition (2°C)	COPd (declared COP)			3.7		3.6		3.7	3.8	3.9	
	Pdh (declared heating cap)			kW	33.6	34.9	36.1	37.5	40.0	42.6	45.1	
	C Condition (7°C)	COPd (declared COP)			6.4		6.3	6.5		6.7	6.8	
	Pdh (declared heating cap)			kW	21.6	22.4	22.8	24.1	25.7	27.4	29.0	
	D Condition (12°C)	COPd (declared COP)			8.7		8.8	8.9	9.0	9.1		
	Pdh (declared heating cap)			kW	10.0		10.3	10.7	12.2	14.4		
	TBivalent	COPd (declared COP)			2.4	2.3	2.4		2.3	2.2	2.1	
	Pdh (declared heating cap)			kW	62.4	64.8	67.0	69.6	74.3	79.0	83.7	
	Tbiv (bivalent temperature)			°C	-10							
	TOL	COPd (declared COP)			2.4	2.3	2.4		2.3	2.2	2.1	
		Pdh (declared heating cap)			kW	62.4	64.8	67.0	69.6	74.3	79.0	83.7
	Space heating (Average climate) recommended combination 2	TOL	Tol (temperature operating limit)			°C	-10					
Space heating (Average climate) recommended combination 3	A Condition (-7°C)	COPd (declared COP)			2.7	2.6	2.7		2.6		2.5	
		Pdh (declared heating cap)			kW	55.2	57.3	59.3	61.6	65.7	69.9	74.0
		COPd (declared COP)			3.7		3.6		3.7		3.8	
	B Condition (2°C)	COPd (declared COP)			33.6		34.9	36.1	37.5	40.0	42.5	45.1
		Pdh (declared heating cap)			kW	6.3	6.2		6.3	6.4		6.5
	C Condition (7°C)	COPd (declared COP)			21.6		22.4	23.2	24.1	25.7	27.3	29.0
		Pdh (declared heating cap)			kW	8.6		8.7	8.8	8.7		
	D Condition (12°C)	COPd (declared COP)			9.9	10.0	10.3	10.7	11.8	13.7		
		Pdh (declared heating cap)			kW	2.4	2.3	2.4		2.2		2.1
	TBivalent	COPd (declared COP)			62.4	64.8	67.0	69.6	74.3	79.0	83.7	
		Tbiv (bivalent temperature)			°C	-10						
		TOL	COPd (declared COP)			2.4	2.3	2.4		2.2		2.1
	Pdh (declared heating cap)			kW	62.4	64.8	67.0	69.6	74.3	79.0	83.7	
	Tol (temperature operating limit)			°C	-10							
Capacity range	HP				42	44	46	48	50	52	54	
PED	Category				Category II							
Maximum number of connectable indoor units					64 (3)							
Indoor index connection	Min.				525.0	550.0	575.0	600.0	625.0	650.0	675.0	
	Max.				1,365.0	1,430.0	1,495.0	1,560.0	1,625.0	1,690.0	1,755.0	
Heat exchanger	Indoor side				Air							
	Outdoor side				Air							
	Air flow rate	Cooling	Rated	m³/h	41,700	42,300	44,580	46,800	46,260	45,720	45,180	
Sound power level	Heating	Nom.		dBA	89.1 (4)	89.8 (4)	89.3 (4)	90.4 (4)	89.8 (4)	89.3 (4)	88.6 (4)	
	Heating	Prated,h		dBA	90.1 (4)	90.5 (4)	90.4 (4)	91.3 (4)	90.9 (4)	90.5 (4)	90.1 (4)	
Sound pressure level	Cooling	Nom.		dBA	66.5 (5)	67.2 (5)	67.0 (5)	67.8 (5)	67.5 (5)	67.1 (5)	66.8 (5)	
Refrigerant	Type				R-410A							
	GWP				2,087.5							
Refrigerant oil	Type				Synthetic (ether) oil FVC68D							
Piping connections	Liquid	Type	OD	mm	Braze connection							
					19.1							
	Gas	Type	OD	mm	Braze connection							
					41.3							
	Total piping length	System	Actual	m	1,000 (6)							
Indication if the heater is equipped with a supplementary heater					no							
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0							

2 Specifications

2 - 1 Specifications

2

Technical specifications System					RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U	RYYQ52U	RYYQ54U
Power consumption in other than active mode	Crankcase heater mode	Cooling	PCK	kW	0.000						
		Heating	PCK	kW	0.206		0.231		0.243	0.255	0.267
	Off mode	Cooling	POFF	kW	0.190		0.223		0.224	0.225	0.226
		Heating	POFF	kW	0.206		0.231		0.243	0.255	0.267
	Standby mode	Cooling	PSB	kW	0.190		0.223		0.224	0.225	0.226
		Heating	PSB	kW	0.206		0.231		0.243	0.255	0.267
	Thermo-stat-off mode	Cooling	PTO	kW	0.024				0.029		
		Heating	PTO	kW	0.251		0.292		0.293	0.294	
	Cooling	Cdc (Degradation cooling)				0.25					
	Heating	Cdh (Degradation heating)				0.25					

Electrical specifications System				RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U	RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U	
Power supply	Name			Y1										
	Phase			3N~										
	Frequency Hz			50										
	Voltage V			380-415										
Power supply intake				Both indoor and outdoor unit										
Voltage range	Min. %			-10										
	Max. %			10										
Current	Nominal running current (RLA)	Cooling	A	22.9 (7)	25.2 (7)	28.1 (7)	30.7 (7)	33.5 (7)	36.0 (7)	38.8 (7)	44.9 (7)	44.3 (7)	43.7 (7)	
Current - 50Hz	Nominal running current (RLA)	Combina-tion A	Cooling	-										
		Combina-tion B	Cooling	-										
	Starting current (MSC) - remark			See note 8										
	Zmax	List			No requirements									
	Minimum Ssc value	kVA/kVa			11,573 (9)	11,597 (9)	12,831 (9)	13,585 (9)	14,843 (9)	15,094 (9)	16,352 (9)	17,359 (8)	19,397 (8)	20,378 (8)
	Minimum circuit amps (MCA)	A			46.0 (10)		51.0 (10)	55.0 (10)	59.0 (10)	62.0 (10)	66.0 (10)	70.0 (9)	76.0 (9)	81.0 (9)
	Maximum fuse amps (MFA)	A			63 (11)				80 (11)			80 (10)	100 (10)	
Power Performance	Power factor	Combina-tion B	35°C ISO - Full load	-										
			46°C ISO - Full load	-										
Wiring connections - 50Hz	For power supply	Quantity			5G									
	For connec-tion with indoor	Quantity			2									
		Remark			F1,F2									

Electrical specifications System				RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U	RYYQ52U	RYYQ54U	
Power supply	Name			Y1							
	Phase			3N~							
	Frequency Hz			50							
	Voltage V			380-415							
Power supply intake				Both indoor and outdoor unit							
Voltage range	Min. %			-10							
	Max. %			10							
Current	Nominal running current (RLA)	Cooling	A	46.2 (7)	48.7 (7)	51.4 (7)	54.0 (7)	56.8 (7)	59.6 (7)	62.4 (7)	
Current - 50Hz	Nominal running current (RLA)	Combina-tion A	Cooling	-							
		Combina-tion B	Cooling	-							
	Starting current (MSC) - remark			See note 8							
	Zmax	List			No requirements						
	Minimum Ssc value	kVa			20,629 (8)	21,132 (8)	21,887 (8)	22,641 (8)	23,899 (8)	25,157 (8)	26,415 (8)
	Minimum circuit amps (MCA)	A			84.0 (9)	86.0 (9)	89.0 (9)	93.0 (9)	97.0 (9)	101.0 (9)	105.0 (9)
	Maximum fuse amps (MFA)	A			100 (10)			125 (10)			
Power Performance	Power factor	Combina-tion B	35°C ISO - Full load	-							
			46°C ISO - Full load	-							
Wiring connections - 50Hz	For power supply	Quantity			5G						
	For connec-tion with indoor	Quantity			2						
		Remark			F1,F2						

2 Specifications

2 - 1 Specifications

Technical specifications Module			RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U
Recommended combination			4 x FXFQ63BVEB	6 x FXFQ50BVEB	4 x FXFQ63BVEB + 2 x FXFQ80BVEB	4 x FXFQ50BVEB	1 x FXFQ50BVEB + 5 x FXFQ63BVEB	3 x FXFQ50BVEB + 5 x FXFQ63BVEB	2 x FXFQ50BVEB + 6 x FXFQ63BVEB
Recommended combination 2			4 x FXSQ63A2VEB	6 x FXSQ50A2VEB	4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	4 x FXSQ50A2VEB	1 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	3 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	2 x FXSQ50A2VEB + 6 x FXSQ63A2VEB
Recommended combination 3			4 x FXMQ63P7VEB9	6 x FXMQ50P7VEB9	4 x FXMQ63P7VEB9 + 2 x FXMQ80P7VEB9	4 x FXMQ50P7VEB9	1 x FXMQ50P7VEB9 + 5 x FXMQ63P7VEB9	3 x FXMQ50P7VEB9 + 5 x FXMQ63P7VEB9	2 x FXMQ50P7VEB9 + 6 x FXMQ63P7VEB9
Cooling capacity	Prated,c	kW	28.0 (1)	33.5 (1)	45.0 (1)	22.4 (1)	40.0 (1)	50.4 (1)	52.0 (1)
Heating capacity	Nom.	6°CWB	28.0 (2)	33.5 (2)	45.0 (2)	22.4 (2)	40.0 (2)	50.4 (2)	56.0 (2)
	Prated,h		28.0 (2)	33.5 (2)	45.0 (2)	22.4 (2)	40.0 (2)	50.4 (2)	56.0 (2)
	Max.	6°CWB	31.5 (2)	37.5 (2)	50.0 (2)	25.0 (2)	45.0 (2)	56.5 (2)	63.0 (2)
COP at nom. capacity	kW/kW	KW/KW	3.69 (2)	3.47 (2)	3.59 (2)	4.15 (2)	3.74 (2)	3.54 (2)	3.2 (2)
ESEER - Automatic			7.2	6.96	6.5	7.53	6.83	6.38	5.67
ESEER - Standard			5.67	5.5	5.05	6.37	5.31	4.97	4.42
SCOP			4.3	4.1	4.0	4.3	4.0	4.2	4.0
SCOP recommended combination 2			4.3	4.1	4.0	4.2	4.0	4.2	4.0
SCOP recommended combination 3			4.1	4.0	4.0	4.2	4.0	4.1	3.9
SEER			6.8	6.3	6.0	7.6	6.3	6.0	5.9
SEER recommended combination 2			6.8	5.9	6.0	6.9	6.3	6.0	5.9
SEER recommended combination 3			6.8	6.2	5.8	7.5	6.2	6.0	5.9
ηs,c			267.6	247.8	236.5	302.4	250.7	238.3	233.7
ηs,c recommended combination 2			270.5	233.5	234.2	273.6	250.0	236.8	233.9
ηs,c recommended combination 3			267.1	246.3	230.4	295.2	246.7	238.2	233.1
ηs,h			168.2	161.4	157.8	167.9	155.4	163.1	156.6
ηs,h recommended combination 2			170.6	161.3	159.5	165.4	157.2	164.8	158.2
ηs,h recommended combination 3			162.0	160.6	156.8	165.6	155.7	159.6	153.4
Space cooling			A Condition EERd (35°C - 27/19) Pdc		2.3	2.4	2.1	3.0	2.6
			B Condition EERd (30°C - 27/19) Pdc		4.7	4.3	3.9	5.2	4.1
			C Condition EERd (25°C - 27/19) Pdc		8.3	7.7	7.1	9.5	7.8
			D Condition EERd (20°C - 27/19) Pdc		13.3	15.9	21.3	10.6	18.9
					17.0	13.9	14.2	18.8	14.3
					9.3	9.4	9.5	8.0	8.4
Space cooling recommended combination 2			A Condition EERd (35°C - 27/19) Pdc		2.4	2.1	2.6	1.9	1.9
			B Condition EERd (30°C - 27/19) Pdc		28.0	33.5	45.0	22.4	40.0
			C Condition EERd (25°C - 27/19) Pdc		4.7	4.0	3.8	4.9	4.1
			D Condition EERd (20°C - 27/19) Pdc		20.6	24.7	33.2	16.5	29.5
					8.5	7.1	7.6	8.8	7.9
					13.3	15.9	21.3	10.6	18.9
Space cooling recommended combination 3			D Condition EERd (20°C - 27/19) Pdc		17.2	13.1	14.0	15.1	14.0
					9.3	9.1	9.5	8.8	8.4
					2.3	2.4	2.1	3.0	2.6
					28.0	33.5	45.0	22.4	40.0
					4.7	4.2	3.7	5.1	4.0
					20.6	24.7	33.2	16.5	29.5
					8.4	7.7	7.4	9.6	7.7
					13.3	15.9	21.3	10.6	19.0
					16.9	13.7	14.1	16.0	14.0
					9.3	9.4	9.5	9.1	8.4
Space heating (Average climate)			TBivalent COPd (declared COP)		2.4	2.0	2.2	2.5	2.3
			Pdh (declared heating cap)		16.0	18.4	23.2	13.7	20.6
			Tbiv (bivalent temperature) °C					-10	
			TOL Tol (temperature operating limit) °C					-10	
			A Condition COPd (declared COP) (-7°C)		2.6	2.4	2.6	2.7	2.6
			Pdh (declared heating cap)		14.2	16.3	20.5	12.1	18.2
			B Condition COPd (declared COP) (2°C)		3.9	3.5	3.9	3.5	3.7
			Pdh (declared heating cap)		8.6	9.9	12.5	7.4	11.1
			C Condition COPd (declared COP) (7°C)		6.4	6.1	6.3	6.1	6.7
			Pdh (declared heating cap)		5.5	6.4	8.0	5.0	7.1
			D Condition COPd (declared COP) (12°C)		8.2	7.9	8.6	7.9	8.5
			Pdh (declared heating cap)		5.9	6.3	4.9	5.9	4.9

2 Specifications

2 - 1 Specifications

Technical specifications Module					RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U	
Space heating (Average climate) recommended combination 2	A Condition (-7°C)	COPd (declared COP)			2.7	2.4	2.6	2.7	2.6	2.4	2.2	
		Pdh (declared heating cap) kW			14.2	16.3	20.5	12.1	18.2	24.7	27.4	
	B Condition (2°C)	COPd (declared COP)			4.0	3.9	3.5	3.9	3.5	3.8	3.7	
		Pdh (declared heating cap) kW			8.6	9.9	12.2	7.4	11.1	15.0	16.7	
	C Condition (7°C)	COPd (declared COP)			6.5	6.1	6.3		6.1	6.8	6.5	
		Pdh (declared heating cap) kW			5.5	6.4	8.0	5.0	7.1	9.7	10.7	
	D Condition (12°C)	COPd (declared COP)			8.3	7.9	8.7	7.8	8.6	9.1	9.2	
		Pdh (declared heating cap) kW			6.0	6.4	5.0	5.9	4.9	7.2		
	TBivalent	COPd (declared COP)			2.4	1.9	2.2	2.4	2.3	1.9	1.8	
		Pdh (declared heating cap) kW			16.0	18.4	23.2	13.7	20.6	27.9	31.0	
		Tbiv (bivalent temperature) °C			-10							
	TOL	COPd (declared COP)			2.4	1.9	2.2	2.4	2.3	1.9	1.8	
Pdh (declared heating cap) kW			16.0	18.4	23.2	13.7	20.6	27.9	31.0			
Tol (temperature operating limit) °C			-10									
Space heating (Average climate) recommended combination 3	A Condition (-7°C)	COPd (declared COP)			2.6	2.4	2.6	2.7	2.6	2.4	2.1	
Space heating (Average climate) recommended combination 3	A Condition (-7°C)	Pdh (declared heating cap) kW			14.2	16.3	20.5	12.1	18.2	24.7	27.4	
		COPd (declared COP)			3.7	3.9	3.5	3.9	3.5	3.7	3.6	
	B Condition (2°C)	Pdh (declared heating cap) kW			8.6	9.9	12.5	7.4	11.1	15.0	16.7	
		COPd (declared COP)			6.4	6.0	6.2		6.1	6.5	6.3	
	C Condition (7°C)	Pdh (declared heating cap) kW			5.5	6.4	8.0	4.9	7.1	9.7	10.7	
		COPd (declared COP)			8.1	7.8	8.6	7.8	8.5	8.7		
	D Condition (12°C)	Pdh (declared heating cap) kW			5.9	6.2	4.9	5.8	4.9	6.9		
		COPd (declared COP)			2.4	2.0	2.2	2.5	2.3	1.9	1.8	
	TBivalent	Pdh (declared heating cap) kW			16.0	18.4	23.2	13.7	20.6	27.9	31.0	
		Tbiv (bivalent temperature) °C			-10							
		COPd (declared COP)			2.4	2.0	2.2	2.5	2.3	1.9	1.8	
	TOL	Pdh (declared heating cap) kW			16.0	18.4	23.2	13.7	20.6	27.9	31.0	
Tol (temperature operating limit) °C			-10									
Capacity range			HP			10	12	16	8	14	18	20
PED	Category				Category II							
	Most critical part				Accumulator							
		Ps*V Bar*I			325		415	325	415	493		
Maximum number of connectable indoor units					64 (3)							
Indoor index connection	Min.				125.0	150.0	200.0	100.0	175.0	225.0	250.0	
	Max.				325.0	390.0	520.0	260.0	455.0	585.0	650.0	
Dimensions	Unit	Height mm			1,685							
		Width mm			930		1,240	930	1,240			
		Depth mm			765							
	Packed unit	Height mm			1,820							
		Width mm			995		1,305	995	1,305			
		Depth mm			860							
Weight	Unit	kg			198		275	198	275	314		
	Packed unit	kg			209		292	209	292	331		
Packing	Material				Carton							
	Weight kg				1.8		2.2	1.8	2.2			
Packing 2	Material				Wood							
	Weight kg				8.9		14.0	8.9	14.0			
Packing 3	Material				Plastic							
	Weight kg				0.5		0.6	0.5	0.6			
Casing	Colour				Daikin White							
	Material				Painted galvanized steel plate							
Heat exchanger	Type				Cross fin coil							
Heat exchanger	Indoor side				Air							
	Air flow rate	Cooling	Rated	m³/h	10,500	11,100	15,600	9,720	13,380	15,060	15,660	
		Heating	Rated	m³/h	10,500	11,100	15,600	9,720	13,380	15,060	15,660	
Fan	Quantity				1		2	1	2			
	External static pressure	Max.	Pa		78							
Fan motor	Quantity				1		2	1	2			
	Type				DC Motor							
Compressor	Output W				550		750	550	750			
	Quantity				1		2	1	2			
Operation range	Type				Hermetically sealed scroll compressor							
	Cooling	Min.	°CDB		-5.0							
Max.		°CDB		43.0								
	Heating	Min.	°CWB		-20.0							
		Max.	°CWB		15.5							
Sound power level	Cooling	Nom.	dBA		79.1 (4)	83.4 (4)	85.6 (4)	78.0 (4)	80.9 (4)	83.8 (4)	87.9 (4)	
	Heating	Prated,h	dBA		80.9 (4)	83.5 (4)	86.5 (4)	79.6 (4)	83.1 (4)	85.3 (4)	89.8 (4)	

2 Specifications

2 - 1 Specifications

Technical specifications Module					RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U
Sound pressure level	Cooling	Nom.		dBA	57.0 (5)	61.0 (5)	63.0 (5)	57.0 (5)	60.0 (5)	62.0 (5)	65.0 (5)
Refrigerant	Type				R-410A						
	GWP				2,087.5						
	Charge			kg	6.0	6.3	11.3	5.9	10.3	11.7	11.8
	Charge			tCO2Eq	12.5	13.2	23.6	12.3	21.5	24.4	24.6
Refrigerant oil	Type				Synthetic (ether) oil FVC68D						
Piping connections	Liquid	Type				Brazed connection					
		OD		mm	9.52	12.7		9.52	12.7	15.9	
	Gas	Type				Brazed connection					
		OD		mm	22.2	28.6		19.1	28.6		
	Equalizing	Type				Brazed connection					
		OD		mm	22.2			19.1	22.2	28.6	
	Total piping length	System	Actual	m	1,000 (6)						
	Defrost method					Reversed cycle					
Capacity control	Method				Inverter controlled						
Indication if the heater is equipped with a supplementary heater					No						
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0						
Power consumption in other than active mode	Crankcase heater mode	Cooling	PCK	kW	0.0						
		Heating	PCK	kW	0.052		0.077	0.052	0.077	0.089	
	Off mode	Cooling	POFF	kW	0.041		0.074	0.041	0.074	0.075	
		Heating	POFF	kW	0.052		0.077	0.052	0.077	0.089	
		Power consumption in other than active mode	Standby mode	Cooling	PSB	kW	0.041		0.074	0.041	0.074
Heating	PSB			kW	0.052		0.077	0.052	0.077	0.089	
Thermo-stat-off mode	Cooling		PTO	kW	0.005		0.01	0.005	0.01		
	Heating		PTO	kW	0.056		0.097	0.056	0.097	0.098	
Cooling	Cdc (Degradation cooling)				0.25						
Heating	Cdh (Degradation heating)				0.25						
Safety devices	Item	01				High pressure switch					
		02				Fan driver overload protector					
		03				Inverter overload protector					
		04				PC board fuse					
		05				Leakage current detector					

Electrical specifications Module				RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U
Power supply	Name	Y1								
	Phase	3N~								
	Frequency		Hz	50						
	Voltage		V	380-415						
Power supply intake				Both indoor and outdoor unit						
Voltage range	Min.		%	-10						
	Max.		%	10						
Current - 50Hz	Nominal running current (RLA)	Combina-tion A	Cooling	-						
		Combina-tion B	Cooling	-						
	Starting current (MSC) - remark			See note 7						
	Zmax	List		No requirements						
	Minimum Ssc value		kVA	5,535 (7)	6,038 (7)	7,547 (7)	4,050 (7)	6,793 (7)	8,805 (7)	9,812 (7)
	Minimum circuit amps (MCA)		A	22.0 (8)	24.0 (8)	31.0 (8)	16.1 (8)	27.0 (8)	35.0 (8)	39.0 (8)
Power Performance	Maximum fuse amps (MFA)		A	25 (9)	32 (9)	40 (9)	20 (9)	32 (9)	40 (9)	50 (9)
		Full load Total	A	1.3 (10)	1.5 (10)	2.6 (10)	1.2 (10)	1.8 (10)	2.6 (10)	
	Power factor	Combina-tion B	35°C ISO - Full load	-						
			46°C ISO - Full load	-						
Wiring connections - 50Hz	For power supply	Quantity		5G						
	For connection with indoor	Quantity		2						
		Remark		F1,F2						

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m |

(3)Actual number of connectable indoor units depends on the indoor unit type (VRV indoor, Hydrobox, RA indoor, etc.) and the connection ratio restriction for the system (50% ≤ CR ≤ 130%) |

(4)Sound power level is an absolute value that a sound source generates. |

(5)Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings. |

(6)Refer to refrigerant pipe selection or installation manual |

(7)In accordance with EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with Ssc ≥ minimum Ssc value |

(8)MCA must be used to select the correct field wiring size. The MCA can be regarded as the maximum running current. |

(9)MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker). |

(10)FLA means the nominal running current of the fan |

RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB |

MSC means the maximum current during start up of the compressor. This unit uses only inverter compressors. Starting current is always ≤ max. running current. |

Maximum allowable voltage range variation between phases is 2%. |

2 Specifications

2 - 1 Specifications

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

The AUTOMATIC ESEER value corresponds with normal VRV4 Heat Pump operation, taking into account advanced energy saving operation functionality (variable refrigerant temperature) |

The STANDARD ESEER value corresponds with normal VRV4 Heat Pump operation, not taking into account advanced energy saving operation functionality |

Sound values are measured in a semi-anechoic room. |

Sound pressure system [dBA] = $10 \cdot \log[10^{A/10} + 10^{B/10} + 10^{C/10}]$, with Unit A = A dBA, Unit B = B dBA, Unit C = C dBA |

EN/IEC 61000-3-12: European/International technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current > 16A and ≤ 75A per phase |

Sc: Short-circuit power |

For detailed contents of standard accessories, see installation/operation manual |

Multi combination (22~54HP) data is corresponding with the standard multi combination

3 Options

3 - 1 Options

RXYQ-U
RYYQ-U
RYMQ-U
RXYQQ-U

No	Item	RXYQ8U RYYQ8U RXYQQ8U	RXYQ10-12U RYYQ10-12U RXYQQ10-12U	RXYQ14-18U RYYQ14-18U RXYQQ14-18U	RXYQ20U RYYQ20U RXYQQ20U	RYYQ22~54U RXYQ22~54U RXYQQ22~42U		
I.	Refnet header	KHRQ22M29H						
		KHRQ22M64H						
		---	---	---	KHRQ22M75H			
II.	Refnet joint	KHRQ22M20T						
		KHRQ22M29T9						
		KHRQ22M64T						
		---	---	---	KHRQ22M75T			
III.	Outdoor multi-connection kit	See note -2-.	---	---	---	---	BHFQ22P1007	
IV.	Outdoor multi-connection kit	See note -2-.	---	---	---	---	BHFQ22P1517	
No	Item	8HP	10HP	12HP	14HP	16HP	18HP	20HP
1a	Cool/heat selector (switch)	See note -3-.	KRC19-26A					
1b	Cool/heat selector (PCB)	BRP2A81						
1c	Cool/heat selector (fixing box)	KJB111A						
2	VRV configurator	EKPCCAB*						
3	Heater tape kit PCB	EKBPH012T7A			EKBPH020T7A			
4	Demand PCB	See	DTA104A61/62*					
5	Demand PCB mounting plate	See note -4-.	---			KKS26B81*		

Notes

- All options are kits
- Only for multi units
- To mount option -1a-, option -1c- is required.
- To install the demand PCB on the large casing type, the demand PCB mounting plate is required.

Medium casing type -VRV4- heat pump: modules -8~12-HP

Large casing type -VRV4- heat pump: modules -14~20-HP

3D120006B

4 Combination table

4 - 1 Combination Table

REMQ5U

REYQ8-20U

RXYQQ8-20U

RXYTQ8-16UYF

RYYQ8-20U

RYMQ8-20U

Unit combination restrictions: VRV4 outdoor units (all models) + 15-class indoor units

Units in scope: FXZQ15A and FXAQ15A.

- In case the system contains these indoor units and the total connection ratio (CR) $\leq 100\%$: no special restrictions. Follow the restrictions that apply to regular VRV DX indoor units.
- In case the system contains these indoor units and the total connection ratio (CR) $> 100\%$: special restrictions apply.
 - When the connection ratio (CR1) of the sum of all FXZQ15A and/or FXAQ15A units in the system $\leq 70\%$, and ALL other VRV DX indoor units have an individual capacity class > 50 : no special restrictions.
 - When the connection ratio (CR1) of the sum of all FXZQ15A and/or FXAQ15A units in the system $\leq 70\%$, and NOT ALL other VRV DX indoor units have an individual capacity class > 50 : the restrictions below apply.
 - $100\% < CR \leq 105\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 70\%$.
 - $105\% < CR \leq 110\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 60\%$.
 - $110\% < CR \leq 115\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 40\%$.
 - $115\% < CR \leq 120\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 25\%$.
 - $120\% < CR \leq 125\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 10\%$.
 - $125\% < CR \leq 130\% \rightarrow$ FXZQ15A and FXAQ15A cannot be used

REMARK

Only the 15-class indoor units explicitly mentioned on this page are in scope. Other indoor units follow the rules that apply to regular VRV DX indoor units.

3D104665

RXYQQ-U

RXYQ-U

RYYQ-U

RYMQ-U

Heat pump VRV4
Multi-unit standard combinations table

		1HP	1.5HP	2HP	2.5HP	3HP	3.5HP	4HP
Heat pump	RXYQ8* / RYYQ8* / RXYQ8*	1						
	RXYQ10* / RYYQ10* / RXYQ10*		1					
	RXYQ12* / RYYQ12* / RXYQ12*			1				
	RXYQ14* / RYYQ14* / RXYQ14*				1			
	RXYQ16* / RYYQ16* / RXYQ16*					1		
	RXYQ18* / RYYQ18* / RXYQ18*						1	
	RXYQ20* / RYYQ20* / RXYQ20*							1
	RXYQ22* / RYYQ22* / RXYQ22*		1	1				
Multi-combination with 2 outdoor units	RXYQ24* / RYYQ24* / RXYQ24*	1				1		
	RXYQ26* / RYYQ26* / RXYQ26*			1	1			
	RXYQ28* / RYYQ28* / RXYQ28*				1	1		
	RXYQ30* / RYYQ30* / RXYQ30*			1			1	
	RXYQ32* / RYYQ32* / RXYQ32*					2		
	RXYQ34* / RYYQ34* / RXYQ34*						1	1
	RXYQ36* / RYYQ36* / RXYQ36*						1	1
	RXYQ38* / RYYQ38* / RXYQ38*	1	1					1
Multi-combination with 3 outdoor units	RXYQ40* / RYYQ40* / RXYQ40*		1	1				1
	RXYQ42* / RYYQ42* / RXYQ42*		1			2		
	RXYQ44* / RYYQ44*			1		2		
	RXYQ46* / RYYQ46*				1	2		
	RXYQ48* / RYYQ48*					3		
	RXYQ50* / RYYQ50*					2	1	
	RXYQ52* / RYYQ52*						1	2
	RXYQ54* / RYYQ54*							3

Remark

RYYQ8-20 = Single continuous heating

RYYQ22-54 Multi continuous heating

RXYQ8-20 = Single non-continuous heating

RXYQ22-54 Multi non-continuous heating

RXYQ8-20 Single non-continuous heating replacement (VRV4-Q)

RXYQ22-4 Multi non-continuous heating replacement (VRV4-Q)

1) For single unit installation RYYQ* units (continuous heating) and RXYQ* units (non-continuous heating)

2) "Non-continuous heating" multi-outdoor-unit combinations consist of RXYQ8-20 units (e.g. RXYQ36*=RXYQ16*+RXYQ20*).

3) "Continuous heating" multi-outdoor-unit combinations consist of RYMQ8-20 units (e.g. RYYQ36*=RYMQ16*+RYMQ20*).

→ RYMQ* units can only be used in multi-outdoor-unit combinations and cannot be used as standalone units.

4) RYYQ8-20 units cannot be used in multi-outdoor-unit combinations.

5) RYYQ8-20 "Continuous heating" multi-outdoor-unit combinations cannot contain RXYQ* units.

6) RXYQ8-20 "Non-continuous heating" multi-outdoor-unit combinations cannot contain RYMQ* units.

7) Multi "Non-continuous heating" replacement models only consist of RXYQ8-20 modules (e.g. RXYQ36*=RXYQ16*+RXYQ20*).

8) Replacement units cannot be combined with other units.

9) T-series outdoor units and U-series outdoor units cannot share the same refrigerant circuit. When combining these units, make sure they are part of separate refrigerant circuits.

3D120060

4 Combination table

4 - 1 Combination Table

RYYQ-U
RYMQ-U

VRV4
Heat pump
Indoor unit combination restrictions
(1/2)

Indoor unit combination pattern	-VRV* DX- indoor unit	-RA DX- indoor unit	Hydrobox unit	Air handling unit (AHU) (2)
-VRV* DX- indoor unit	O	O	O	O
-RA DX- indoor unit	O	O	X	X
Hydrobox unit	O	X	O ₁	X
Air handling unit (3) (4)	O	X	X	O ₂

O: Allowed
X: Not allowed

Notes

1. -VRV* DX- indoor unit
 - When combining -VRV DX- indoor units with other types of indoor units, respect the following combination patterns:
Example
Allowed : {-VRV DX- indoor unit + Hydrobox- unit} or {-VRV DX- indoor unit + -RA DX- indoor unit} or {-VRV DX- indoor unit + -AHU-}
Not allowed : {-VRV DX- indoor unit + {-RA DX- indoor unit & {-Hydrobox- unit or -AHU-}}} or {-VRV DX- indoor unit + {-Hydrobox- unit & {-RA DX- indoor unit or -AHU-}}}
 2. O₁
 - Only connect -Hydrobox- units to a -VRV IV- Heat Pump in combination with a -VRV DX- indoor unit.
→ Refer to the connection ratio restrictions (3D079540 & 3D117169-).
→ Connection with only Hydrobox units: refer to the Daikin Altherma solutions.
 - Only connect -Hydrobox- units of the -HXY* series.
→ -HXHD* series -Hydrobox- units are not allowed.
 3. O₂
 - Combination of AHU only + control box -EKEQFA- or -EKEACBVE- (maximum -54- HP for -400 + 2x500 EKE XV- class or -450 + 2 x500 EKE XV A- class kit; maximum -42- HP for -140 + 2 x500 EKE XV- or -EKE XV A- class kit for cold region VRV)
The combination with -VRV DX- indoor units is not allowed.
→ -X- control is possible [-{EKE XV + EKEQFA*}/(EKE XV A + EKEACBVE)- boxes]. No Variable Refrigerant Temperature control possible.
→ -Y- control is possible [-{EKE XV + EKEQFA*}/(EKE XV A + EKEACBVE)- boxes]. No Variable Refrigerant Temperature control possible.
→ -W- control is possible [-{EKE XV + EKEQFA*}/(EKE XV A + EKEACBVE)- boxes]. No Variable Refrigerant Temperature control possible.
→ -Z, Z'- control is possible [-EKE XV A + EKEACBVE- boxes].
- Combination of -AHU- only + control box -EKEQMA- (not combined with -VRV DX- indoor units)
→ -Z- control is possible [-EKE XV + EKEQMA* - boxes].
 4. Combination of -AHU- and -VRV DX- indoor units
 - -Z- control is possible [-EKEQMA* - boxes].
 - -Z, Z'- control is possible [-EKEACBVE- boxes].
 5. The combination of -AHU- with -Hydrobox- units or -RA DX- indoor units is not allowed.
 6. (3) The following units are considered AHUs:
 - [-EKE XV + EKEQ(MA/FA)] / (EKE XV A + EKEACBVE) + AHU- coil
 - -Biddle- air curtain
 - -FXMQ_MF- units
- Information
- -VKM- units are considered to be regular -VRV DX- indoor units.

3D079543G

RYYQ-U
RYMQ-U

VRV4
Heat pump
Indoor unit combination restrictions
(2/2)

Combination table	RYYQ*	RYYQ*	RXYQ* RXMLQ* RXYLQ*	RXYQ* RXMLQ* RXYLQ*
	Single continuous heating	Multi continuous heating	Single non-continuous heating	Multi non-continuous heating
-VRV* DX- indoor unit	O	O	O	O
-RA DX- indoor unit	O	X	O	X
Hydrobox unit	O	O ₁	O	O ₁
Air handling unit (AHU) (2)	O	O	O	O

O: Allowed
X: Not allowed

Notes

1. O₁
 - Available upon request through the -SPN- procedure.
2. The following units are considered AHUs:
 - [-EKE XV + EKEQ(MA/FA)] / (EKE XV A + EKEACBVE) + AHU- coil
 - -Biddle- air curtain
 - -FXMQ_MF- units

3D079543G

4 Combination table

4 - 1 Combination Table

RXYQ-U

RYYQ-U

RYMQ-U

Compatibility list: ·VRV4· heat pump - ·RA DX· indoor unit

Wall mounted type	Emura	FTXJ20A FTXJ25A FTXJ35A FTXJ42A FTXJ50A FTXA20 FTXA25 FTXA35 FTXA42 FTXA50 FTXM20R FTXM25R FTXM35R FTXM42R FTXM50R FTXM60R FTXM71R
Ceiling/wall mounted	Flex	FLXS25B FLXS35B FLXS50B FLXS60B
Floor standing type	FVXM	FVXM25F FVXM35F FVXM50F FVXM25A FVXM35A FVXM50A CVXM20A
	Nexura	FVXG25K FVXG35K FVXG50K

Remark

The limitations on the use of ·RA DX· indoor units with the ·VRV4· Heat Pump are subject to the rules set out in drawings ·3D079543· and ·3D079540·.

If you want to connect ·RA·/·SA· ·DX· cassette, ceiling-mounted, or duct indoor units, use their ·VRV DX· indoor unit equivalents instead.

3D082373H


5 Capacity tables

5 - 1 Capacity Table Legend

In order to fulfill more your requirements on quick access of data in the format you require, we have developed a tool to consult capacity tables.

Below you can find the link to the capacity table database and an overview of all the tools we have to help you select the correct product:

- **Capacity table database:** lets you find back and export quickly the capacity information you are looking for based upon unit model, refrigerant temperature and connection ratio.
- You can access the capacity table viewer here:
<https://vrvxpress2.daikin.eu/CTV#/capacity>



- An overview of **all software tools** that we offer can be found here:
- https://my.daikin.eu/denv/en_US/library/applications/software-finder.html



5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ-U

RXYQ-U

RYYQ-U

RYMQ-U

VRV4

Heat pump

Integrated heating capacity coefficient

The heating capacity tables do not take into account the capacity reduction in case of frost accumulation or defrost operation.
The capacity values that take these factors into account, or in other words, the integrated heating capacity values, can be calculated as follows:

Formula

A = Integrated heating capacity

B = Capacity characteristics value (see table)

C = Integrated correction factor for frost accumulation (see table)

A = B * C

Inlet air temperature of heat exchanger


	[°C DB/°C WB] 1/7/7.6 or less	-5/-5.6	-3/-3.7	0/-0.7	3/2.2	5/4.1	7/6
Integrated correction factor for frost accumulation C							
8HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00
10HP	0.95	0.93	0.87	0.79	0.80	0.88	1.00
12HP	0.95	0.92	0.87	0.75	0.76	0.85	1.00
14HP	0.95	0.92	0.86	0.72	0.73	0.84	1.00
16HP	0.95	0.92	0.86	0.72	0.72	0.83	1.00
18HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00
20HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00
22HP	0.95	0.92	0.87	0.77	0.78	0.86	1.00
24HP	0.95	0.92	0.87	0.75	0.76	0.85	1.00
26HP	0.95	0.92	0.86	0.73	0.74	0.84	1.00
28HP	0.95	0.92	0.86	0.73	0.74	0.84	1.00
30HP	0.95	0.93	0.87	0.80	0.81	0.88	1.00
32HP	0.95	0.92	0.86	0.71	0.72	0.83	1.00
34HP	0.95	0.92	0.87	0.78	0.79	0.87	1.00
36HP	0.95	0.92	0.87	0.78	0.79	0.87	1.00
38HP	0.95	0.93	0.88	0.83	0.84	0.89	1.00
40HP	0.95	0.93	0.87	0.80	0.81	0.88	1.00
42HP	0.95	0.92	0.86	0.73	0.74	0.84	1.00
44HP	0.95	0.92	0.86	0.72	0.73	0.84	1.00
46HP	0.95	0.92	0.86	0.72	0.72	0.83	1.00
48HP	0.95	0.92	0.86	0.71	0.72	0.83	1.00
50HP	0.95	0.92	0.87	0.76	0.77	0.86	1.00
52HP	0.95	0.93	0.87	0.80	0.81	0.88	1.00
54HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00

Notes

The figure shows the integrated heating capacity for a single cycle (from one defrost operation to the next).

When there is an accumulation of snow against the outdoor unit heat exchanger, there will always be a temporary reduction in capacity depending on the outdoor temperature (°C DB), relative humidity (RH) and the amount of frosting which occurs.

The multi-combination data 22~54HP corresponds with the standard multi-combination of drawing 3D079534.


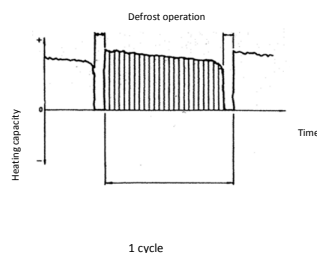


3D079898A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ8U
RXYQ8U
RYYQ8U
RYMQ8U

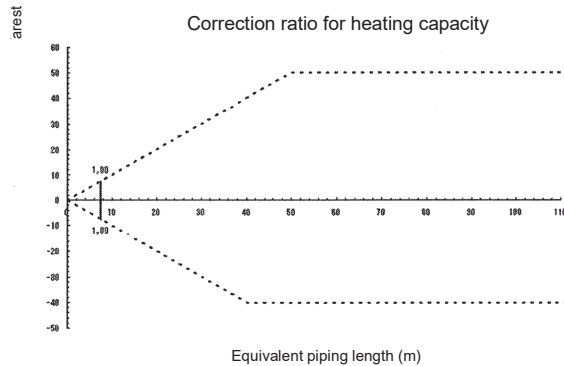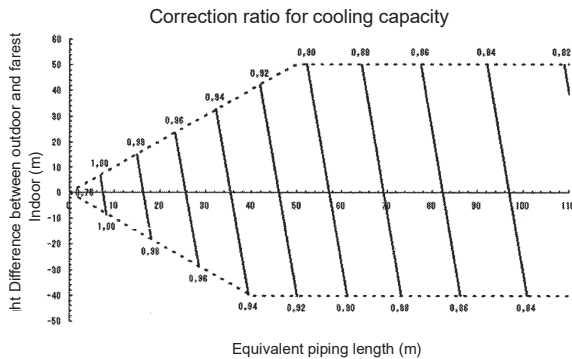

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.

- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.

- Method of calculating the capacity of the outdoor units

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\begin{array}{|c|} \hline \text{Maximum capacity of outdoor units} \\ \hline \end{array} = \begin{array}{|c|} \hline \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \\ \hline \end{array} \times \begin{array}{|c|} \hline \text{Correction ratio of piping to furthest indoor} \\ \hline \end{array}$$

Condition: Indoor connection ratio exceeds 100%.

$$\begin{array}{|c|} \hline \text{Maximum capacity of outdoor units} \\ \hline \end{array} = \begin{array}{|c|} \hline \text{Capacity of outdoor units from capacity table at installed connection ratio} \\ \hline \end{array} \times \begin{array}{|c|} \hline \text{Correction ratio of piping to furthest indoor} \\ \hline \end{array}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
8HP	22.2	12.7

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
8HP	19.1	9.5


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{array}{|c|} \hline \text{Equivalent piping length} \\ \hline \end{array} = \begin{array}{|c|} \hline \text{Equivalent length of main pipe} \\ \hline \end{array} \times \begin{array}{|c|} \hline \text{Correction factor} \\ \hline \end{array} + \begin{array}{|c|} \hline \text{Equivalent length of branch pipes} \\ \hline \end{array}$$

Choose the correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

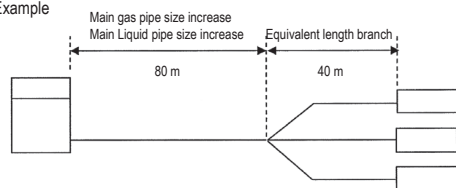

In the above case (Cooling) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.86
heating capacity when height difference = 0 is thus approximately 1.0


3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

5

RXYQQ10U
RXYQ10U
RYYQ10U
RYMQ10U

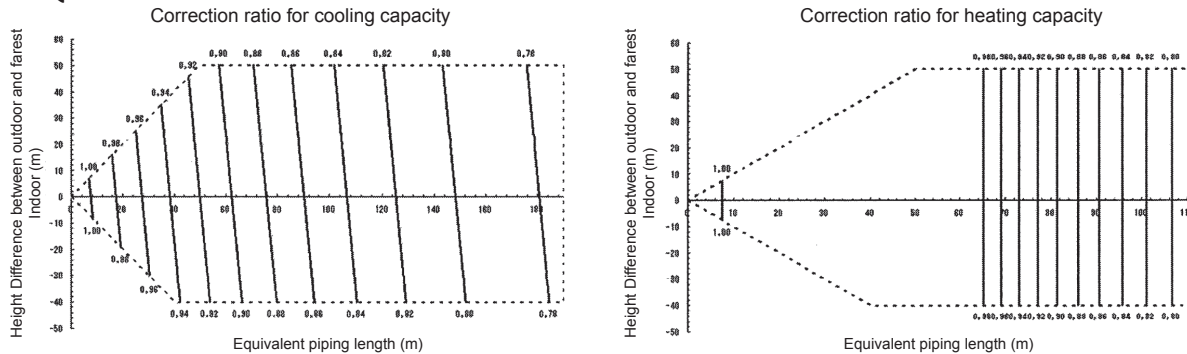

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.

- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.

Method of calculating the capacity of the outdoor units

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\begin{aligned} \text{Maximum capacity of outdoor units} &= \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \\ &\times \text{Correction ratio of piping to furthest indoor} \end{aligned}$$

Condition: Indoor connection ratio exceeds 100%.

$$\begin{aligned} \text{Maximum capacity of outdoor units} &= \text{Capacity of outdoor units from capacity table at installed connection ratio} \\ &\times \text{Correction ratio of piping to furthest indoor} \end{aligned}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
RXYQ10P	25.4*	12.7

*If not available on site, do not increase. If not increased correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
10 HP	22.2	9.5


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Equivalent piping length} &= \\ \text{Equivalent length of main pipe} &\times \text{Correction factor} \\ + \\ \text{Equivalent length of branch pipes} \end{aligned}$$

Choose the correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

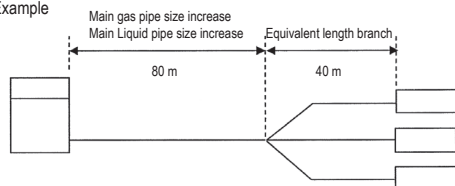

In the above case (Cooling) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m



The rate of change in cooling capacity when height difference = 0 is thus approximately 0.87
heating capacity when height difference = 0 is thus approximately 0.90

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ12,14,16,24,36U
RXYQ12,14,24,36U
RYYQ12,14,24,36U
RYMQ12,14U

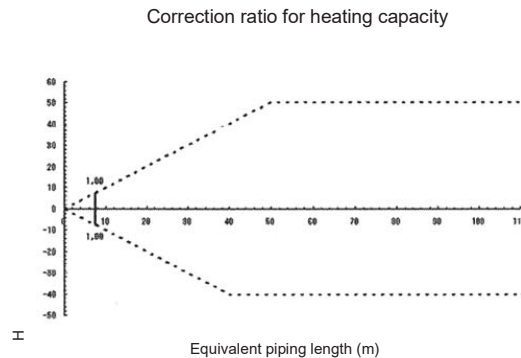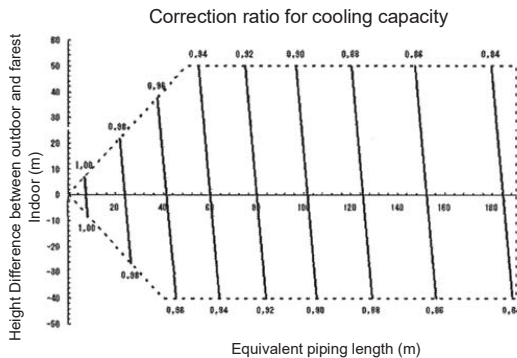

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\begin{aligned} \text{Maximum capacity of outdoor units} &= \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \\ &\times \text{Correction ratio of piping to furthest indoor} \end{aligned}$$

Condition: Indoor connection ratio exceeds 100%.

$$\begin{aligned} \text{Maximum capacity of outdoor units} &= \text{Capacity of outdoor units from capacity table at installed connection ratio} \\ &\times \text{Correction ratio of piping to furthest indoor} \end{aligned}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
12 HP	28.6	15.9
14 HP	28.6	15.9
24 HP	34.9	19.1
36 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).
*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
12 HP	28.6	12.7
14 HP	28.6	12.7
24 HP	34.9	15.9
36 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Equivalent piping length} &= \\ \text{Equivalent length of main pipe} &\times \text{Correction factor} \\ + \\ \text{Equivalent length of branch pipes} \end{aligned}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.89
Heating (liquid pipe)	1.0	0.5

Example

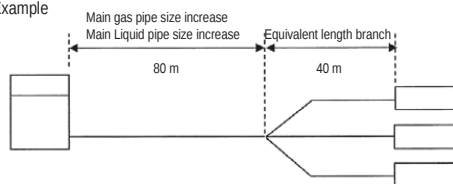

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m

The rate of change in cooling capacity when height difference = 0 is thus approximately 0.89
heating capacity when height difference = 0 is thus approximately 1.0


3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ16U
RXYQ16U
RYYQ16U
RYMQ16U

5

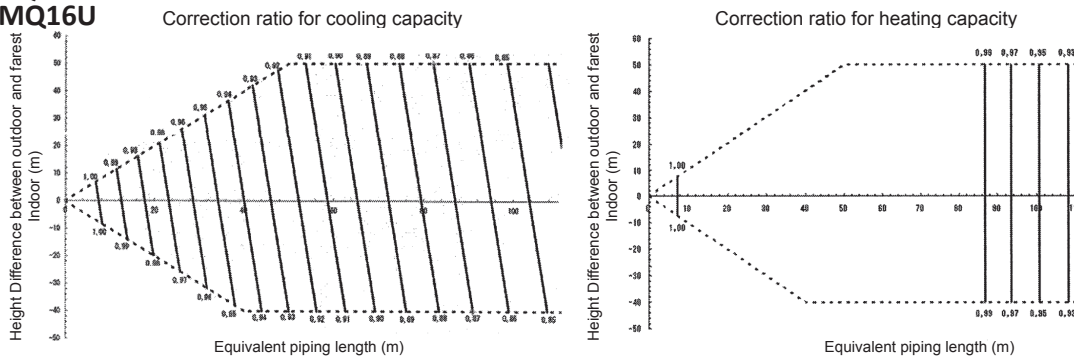

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
16 HP	31.8"	15.9

*If not available on site, do not increase. If not increased correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
16 HP	28.6	12.7


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

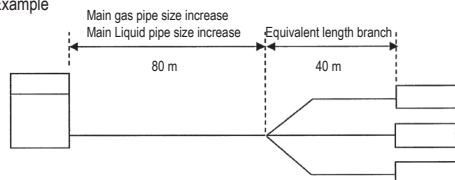

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m

The rate of change in cooling capacity when height difference = 0 is thus approximately 0.88
heating capacity when height difference = 0 is thus approximately 0.99

3D079897A

5 Capacity tables



5 - 2 Capacity Correction Factor

RXYQQ18,26,28,30,38,40,42,44U

RXYQ18,26,28,30,38,40,42,44U

RYYQ18,26,28,30,38,40,42,44U

RYMQ18U

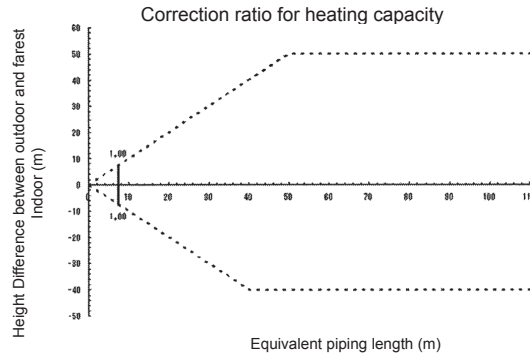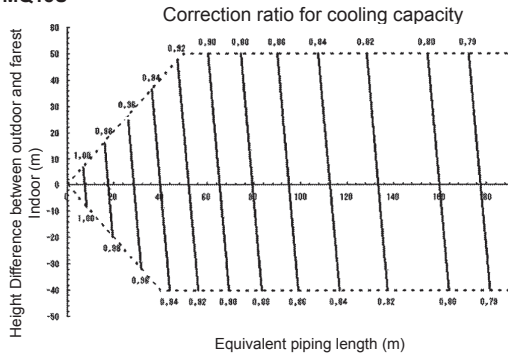

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.

- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.

- Method of calculating the capacity of the outdoor units

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.

For new diameters, see below.

Model	Gas	Liquid
18 HP	31.8*	19.1
26~30 HP	38.1*	22.2
38~44 HP	41.3	22.2

*If not available on site, do not increase. If not increased correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
18 HP	28.6	15.9
26~30 HP	34.9	19.1
38~44 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Equivalent piping length} &= \\ &\text{Equivalent length of main pipe} \times \text{Correction factor} \\ &+ \\ &\text{Equivalent length of branch pipes} \end{aligned}$$

Choose the correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

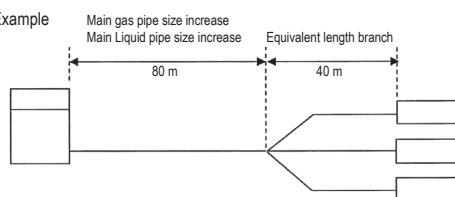

In the above case (for RXYQ38-44) (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m

(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m



The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83 heating capacity when height difference = 0 is thus approximately 1.0

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ20,32,34U
RXYQ20,32,34U
RYYQ20,32,34U
RYMQ20,32,34U

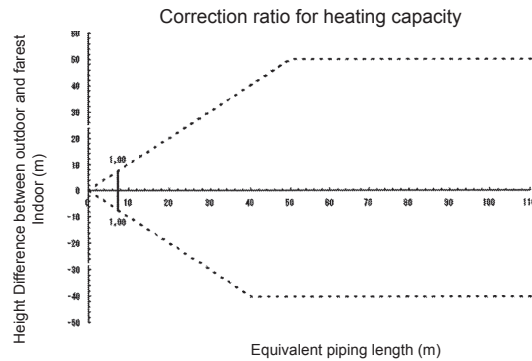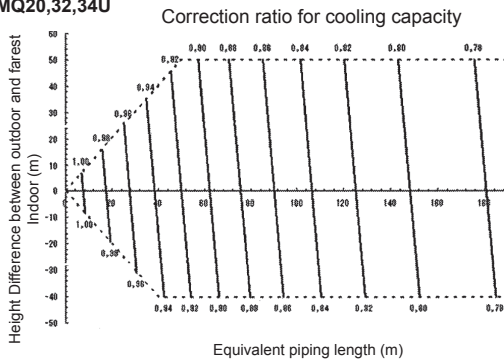

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
20 HP	31.8*	19.1
32/34 HP	38.1*	22.2

*If not available on site, do not increase. If not increased correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
20 HP	28.6	15.9
32/34 HP	34.9	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

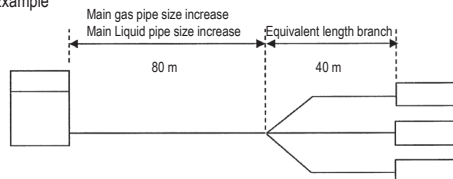

In the above case (Cooling) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.88
heating capacity when height difference = 0 is thus approximately 1.0

3D079897A

5 Capacity tables



5 - 2 Capacity Correction Factor

RXYQQ22U

RXYQ22U

RYYQ22U

RYMQ22U

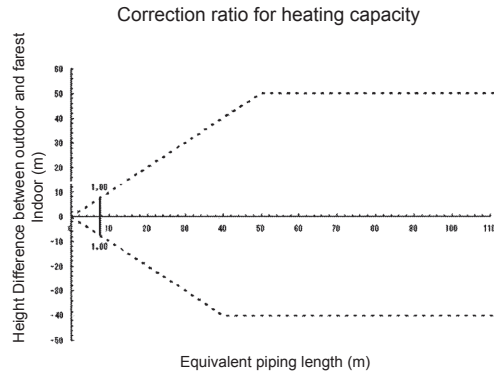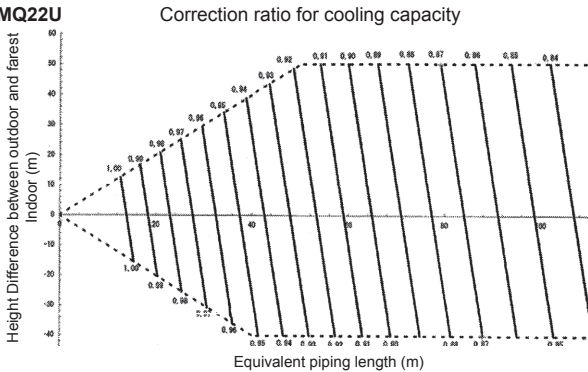

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
22 HP	31.8*	19.1

* If not available on site, do not increase, if not increased, no correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).
*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
22 HP	28.6	15.9


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Overall equivalent length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

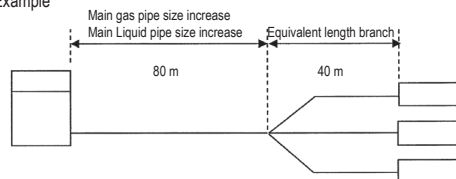

In the above case (Cooling) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.88
heating capacity when height difference = 0 is thus approximately 1.0

3D079897A



5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ46U

RXYQ46U

5

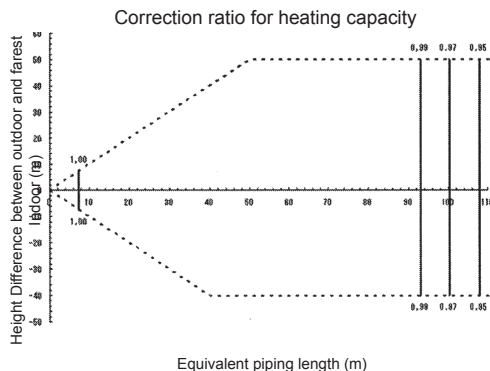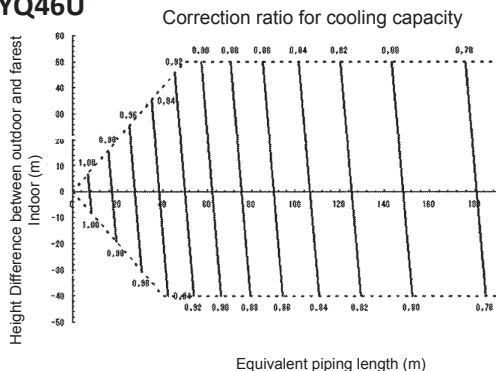

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
46 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
46 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Equivalent piping length} &= \\ \text{Equivalent length of main pipe} &\times \text{Correction factor} \\ + \\ \text{Equivalent length of branch pipes} \end{aligned}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

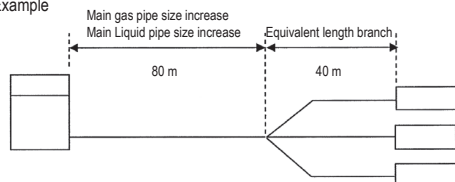

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 1.0

3D079897A



5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ48U

RXYQQ48U

RXYQ48U

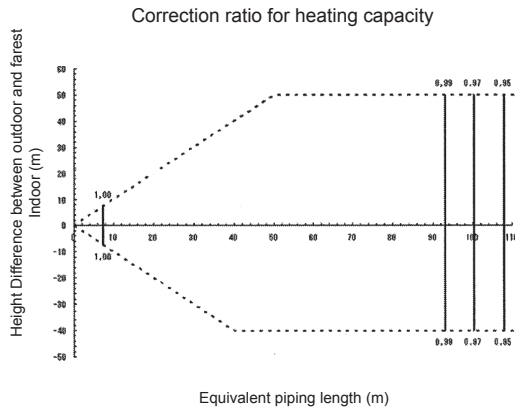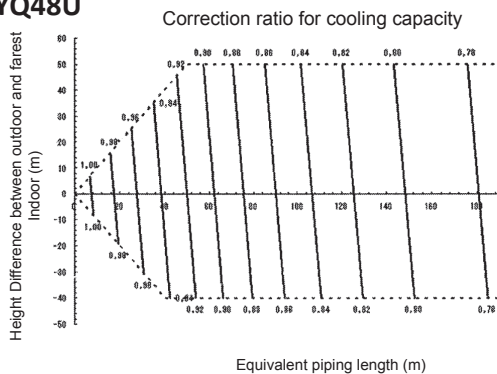

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
48 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
48 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

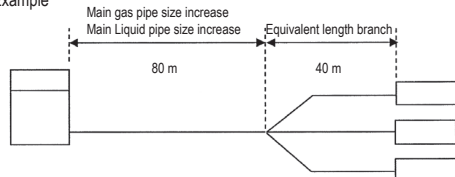

In the above case (Cooling) Overall equivalent length = $80 \text{ m} \times 1.0 + 40 \text{ m} = 120 \text{ m}$
(Heating) Overall equivalent length = $80 \text{ m} \times 0.5 + 40 \text{ m} = 80 \text{ m}$
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.97



3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ50U
RXYQ50U
RXYQ50U

5

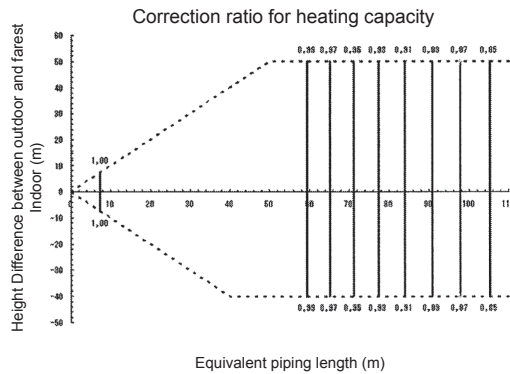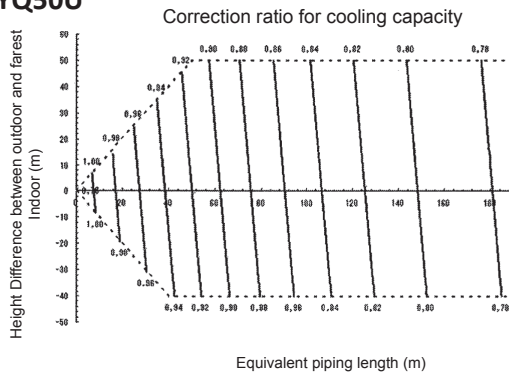

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
50 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
50 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

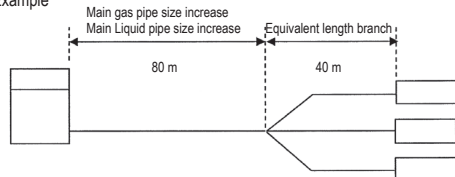



In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.92

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ52U
RXYQ52U
RXYQ52U

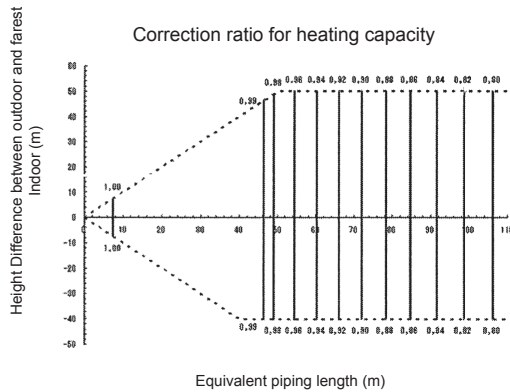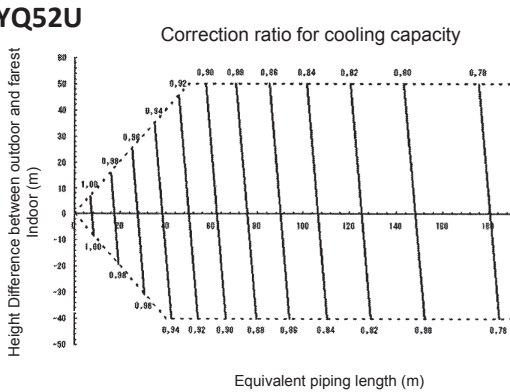

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
52 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
52 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

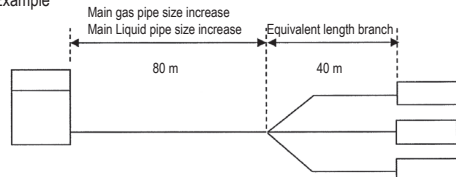

In the above case (Cooling) Overall equivalent length = $80 \text{ m} \times 1.0 + 40 \text{ m} = 120 \text{ m}$
(Heating) Overall equivalent length = $80 \text{ m} \times 0.5 + 40 \text{ m} = 80 \text{ m}$
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.88



3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ54U
RXYQQ54U
RXYQ54U

5

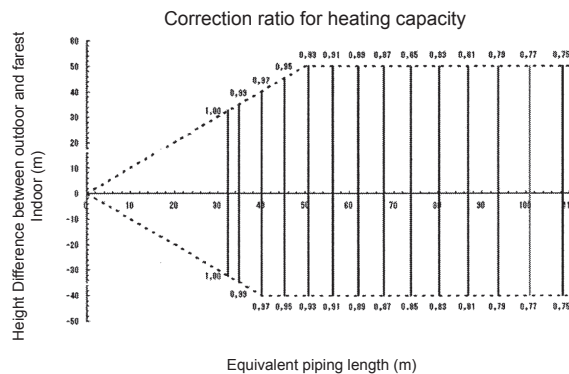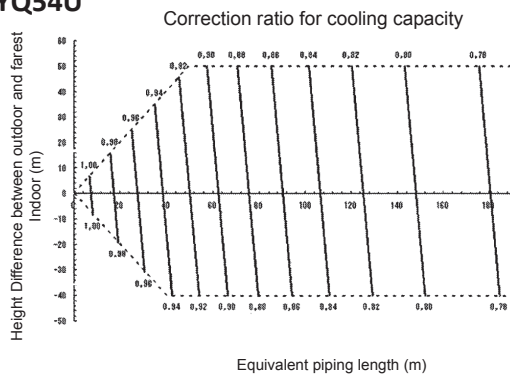

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
54 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).
*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
54 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

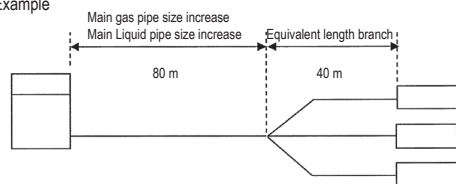

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m


The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.83

3D079897A

6 Dimensional drawings


6 - 1 Dimensional Drawings

RYYQ8-12U
RYMQ8-12U

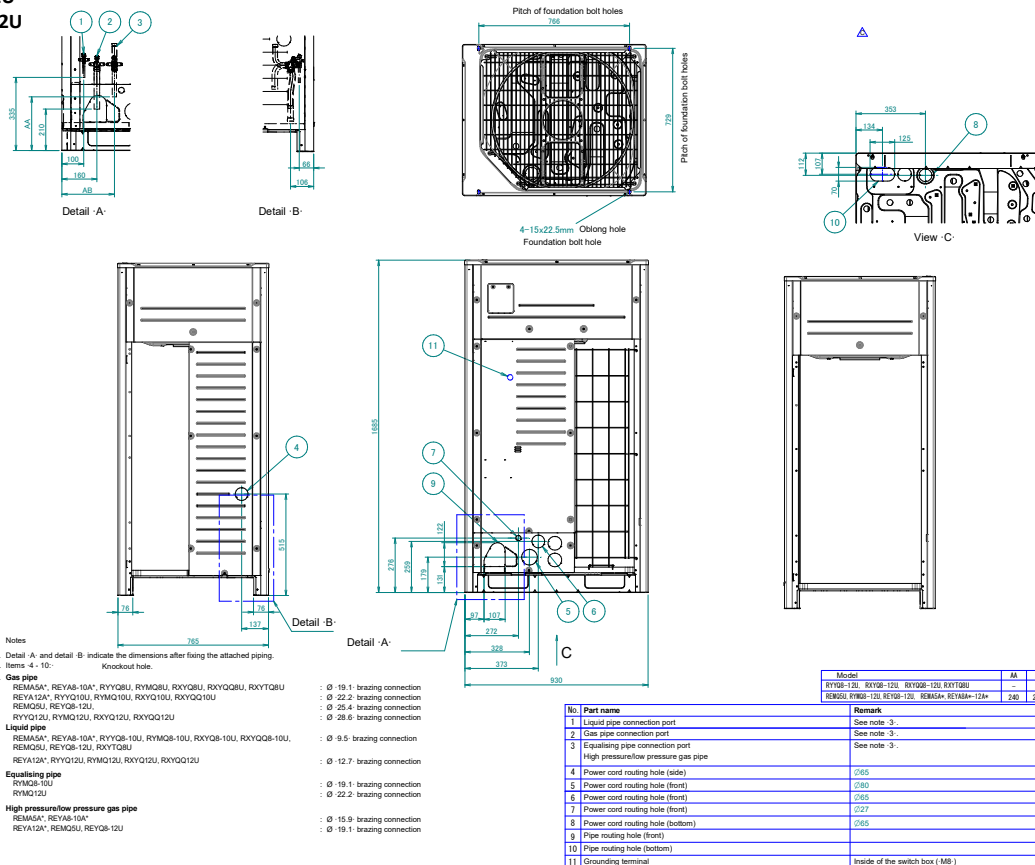

2D119001D

RYYQ14-20U
RYMQ14-20U

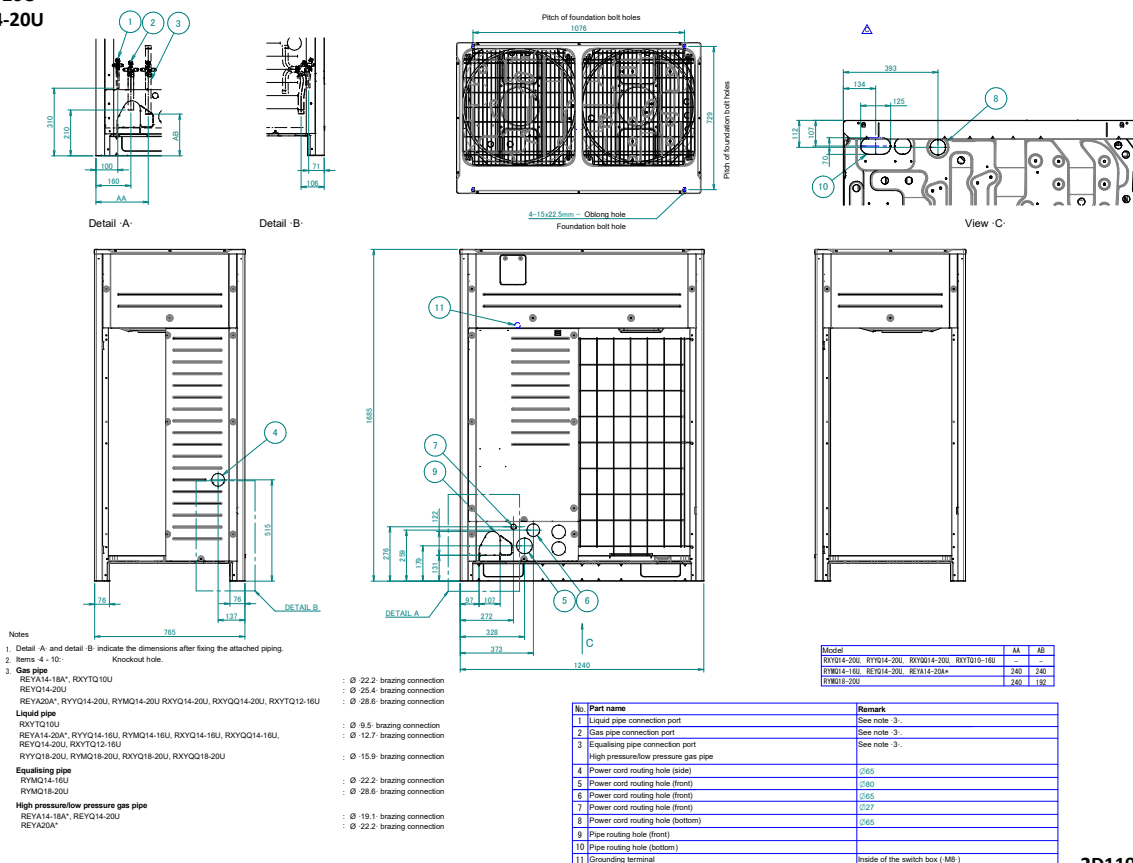


2D119091D

7 Centre of gravity

7 - 1 Centre of Gravity


7

RYYQ8-12U
RYMQ8-12U

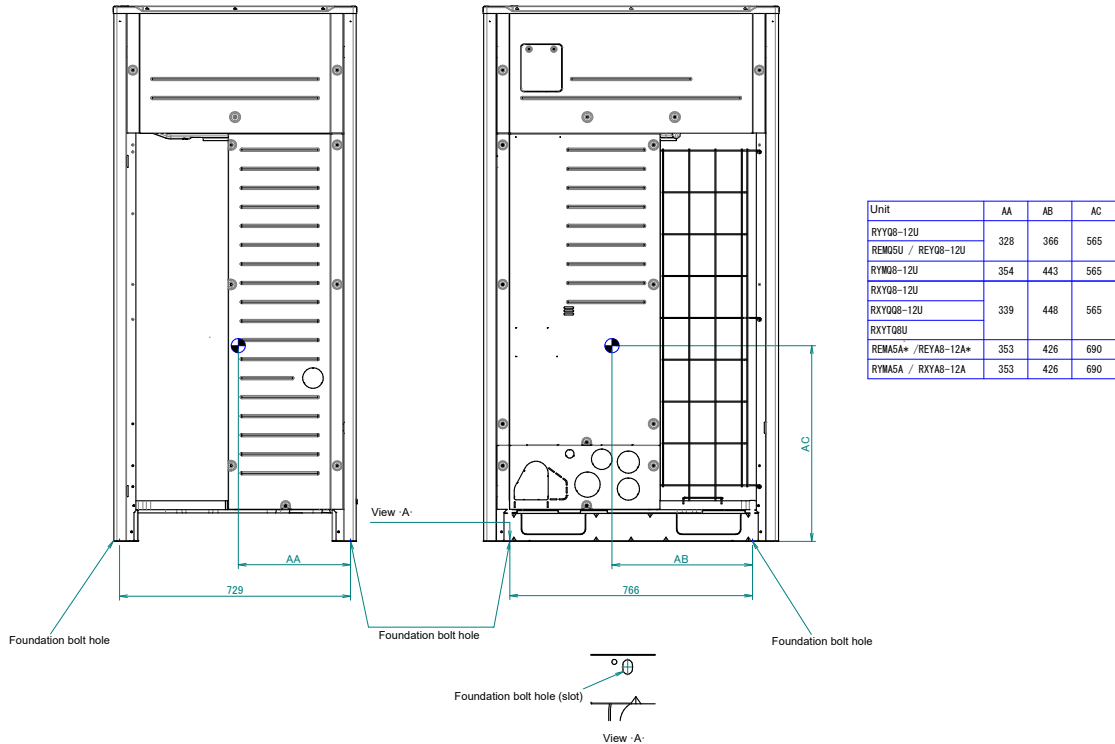

3D119703C



RYYQ14-20U
RYMQ14-20U

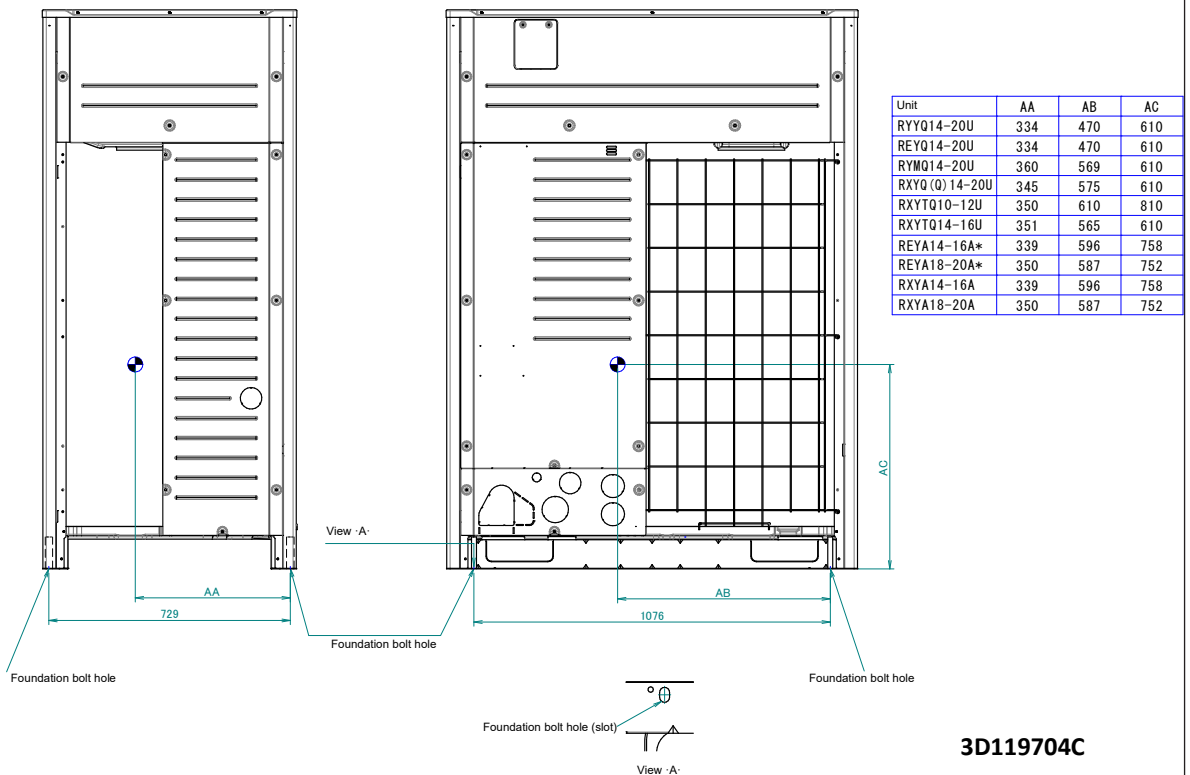

3D119704C

8 Piping diagrams

8 - 1 Piping Diagrams

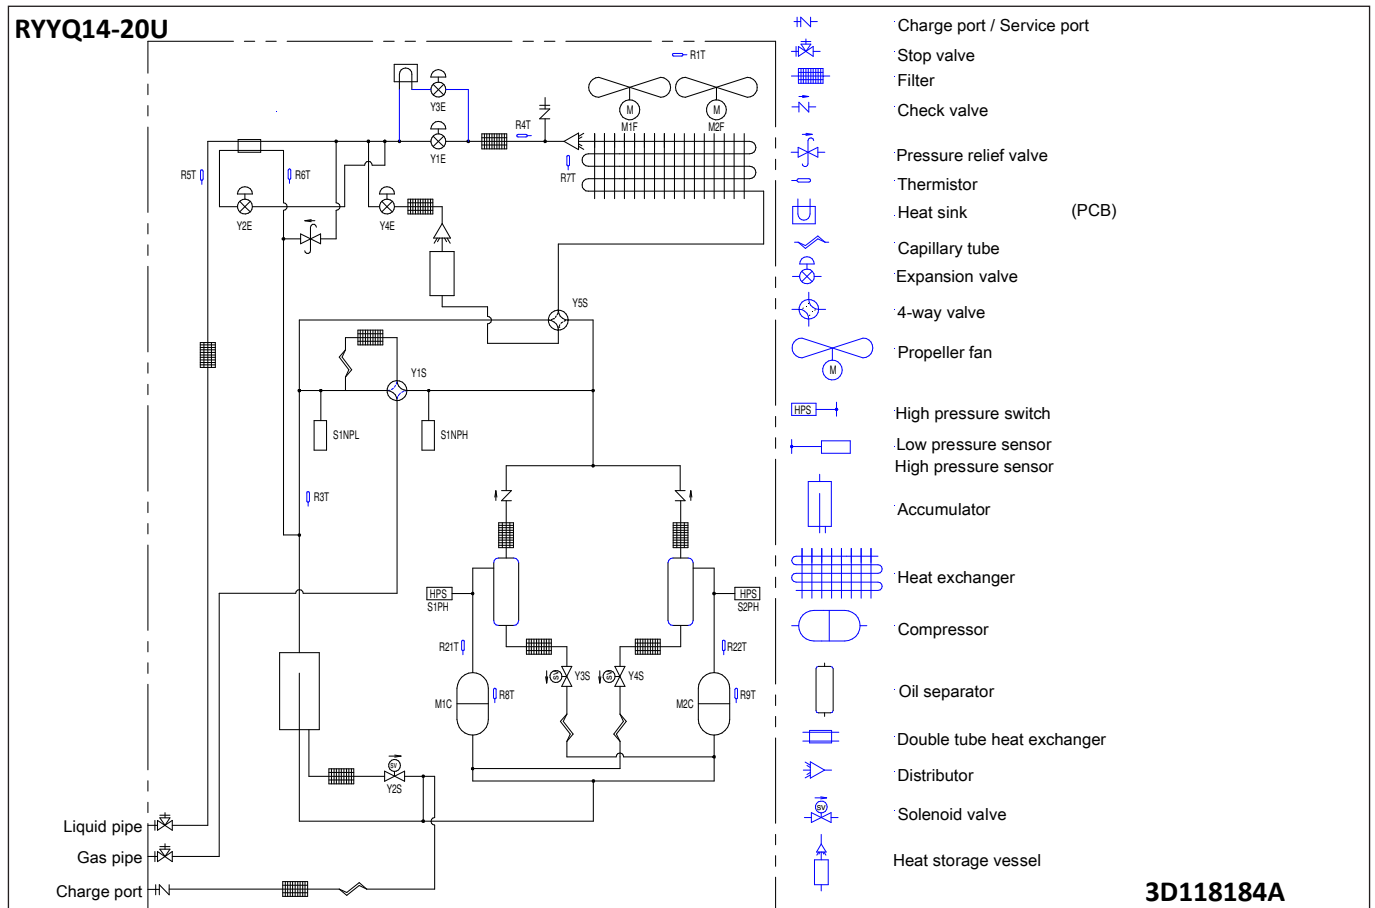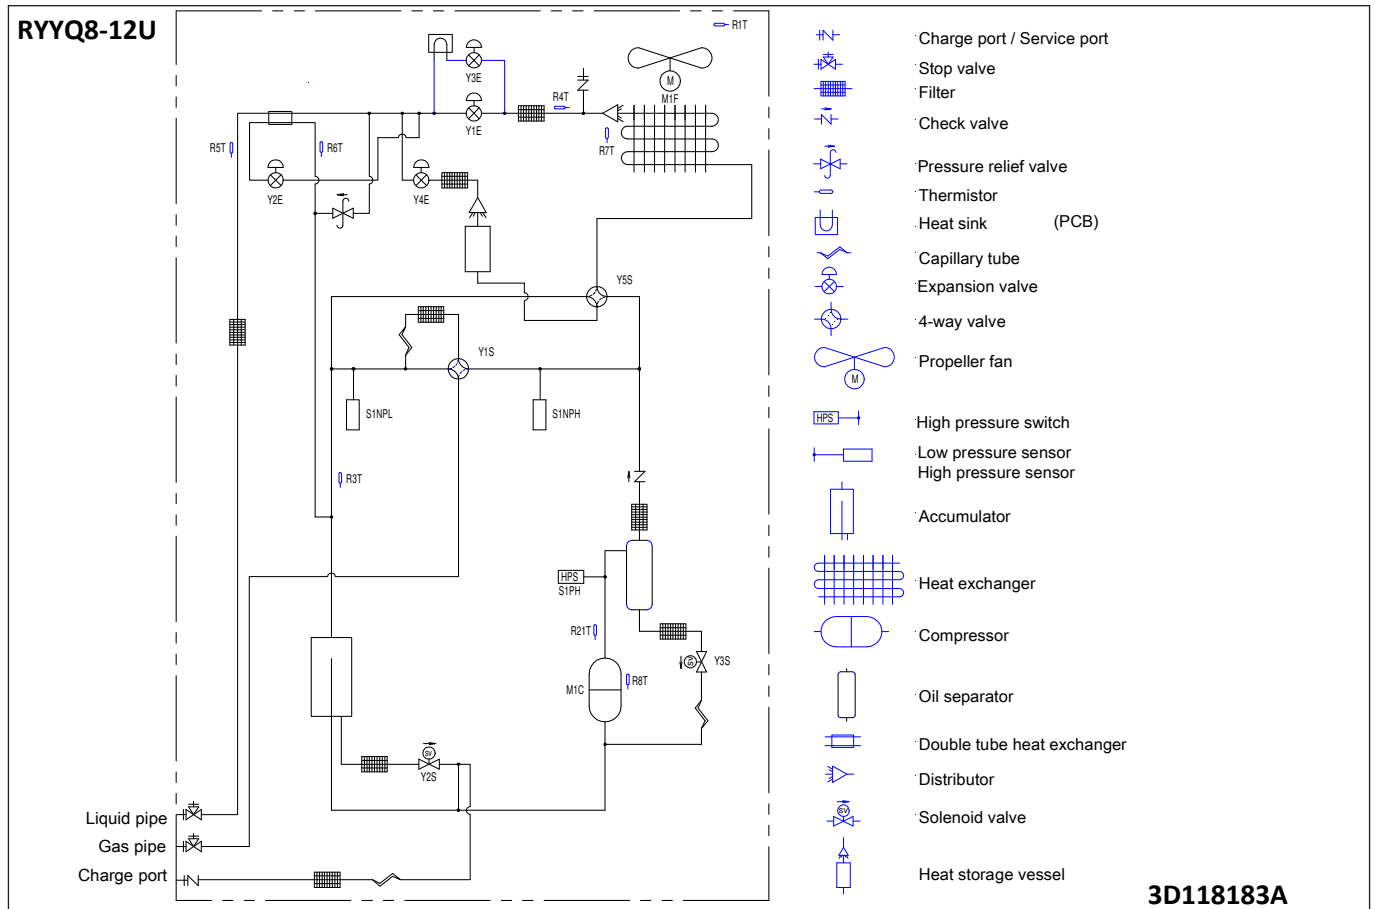


8 Piping diagrams

8 - 1 Piping Diagrams

8


RYMQ8-12U

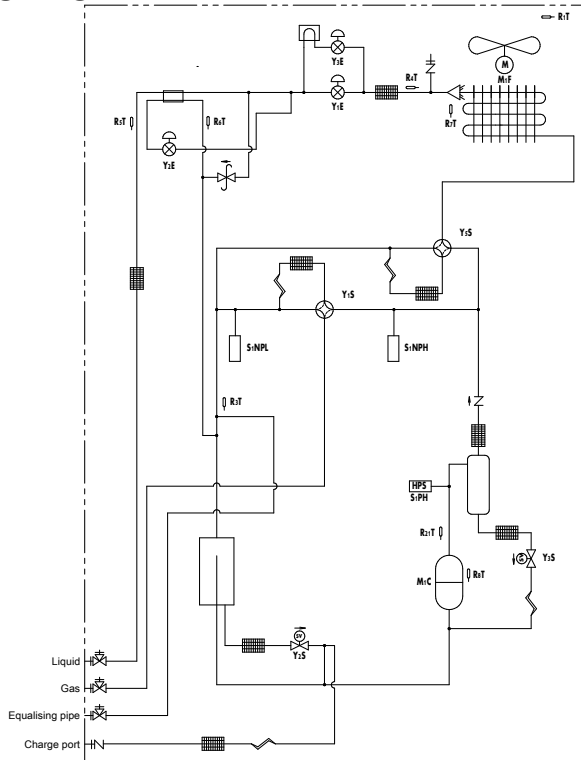

- Charge port / Service port
- Stop valve
- Filter
- Check valve
- Pressure relief valve
- Thermistor
- Heat sink (PCB)
- Capillary tube
- Expansion valve
- 4-way valve
- Propeller fan
- High pressure switch
- Low pressure sensor
- High pressure sensor
- Accumulator
- Heat exchanger
- Compressor
- Oil separator
- Double tube heat exchanger
- Distributor
- Solenoid valve

3D118185

RYMQ14-20U

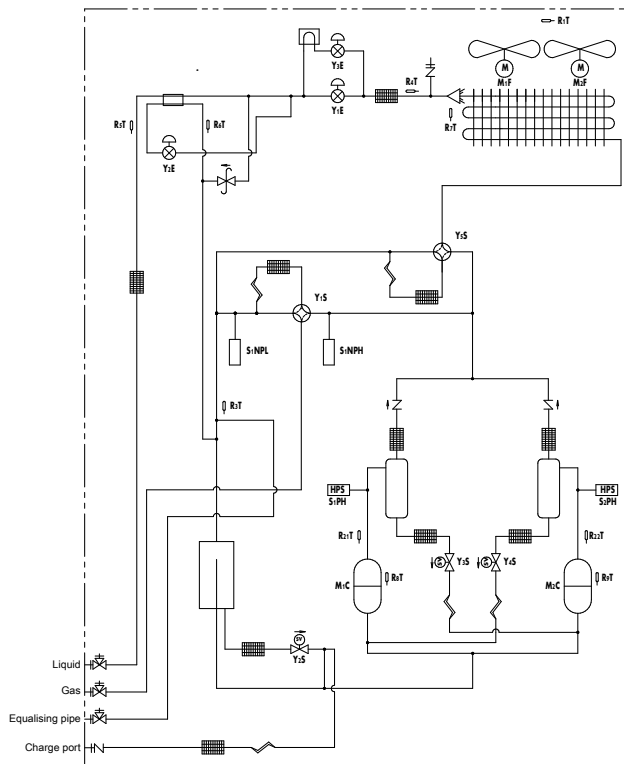

- Charge port / Service port
- Stop valve
- Filter
- Check valve
- Pressure relief valve
- Thermistor
- Heat sink (PCB)
- Capillary tube
- Expansion valve
- 4-way valve
- Propeller fan
- High pressure switch
- Low pressure sensor
- High pressure sensor
- Accumulator
- Heat exchanger
- Compressor
- Oil separator
- Double tube heat exchanger
- Distributor
- Solenoid valve

3D118186


9 Wiring diagrams

9 - 1 Wiring Diagrams - Three Phase


RXYQ8-12U
RXYTQ8UYF
RYYQ8-12U
RYMQ8-12U

Power supply 3N~ 380-415V 50Hz
3N~ 380V 60Hz

Wiring diagram

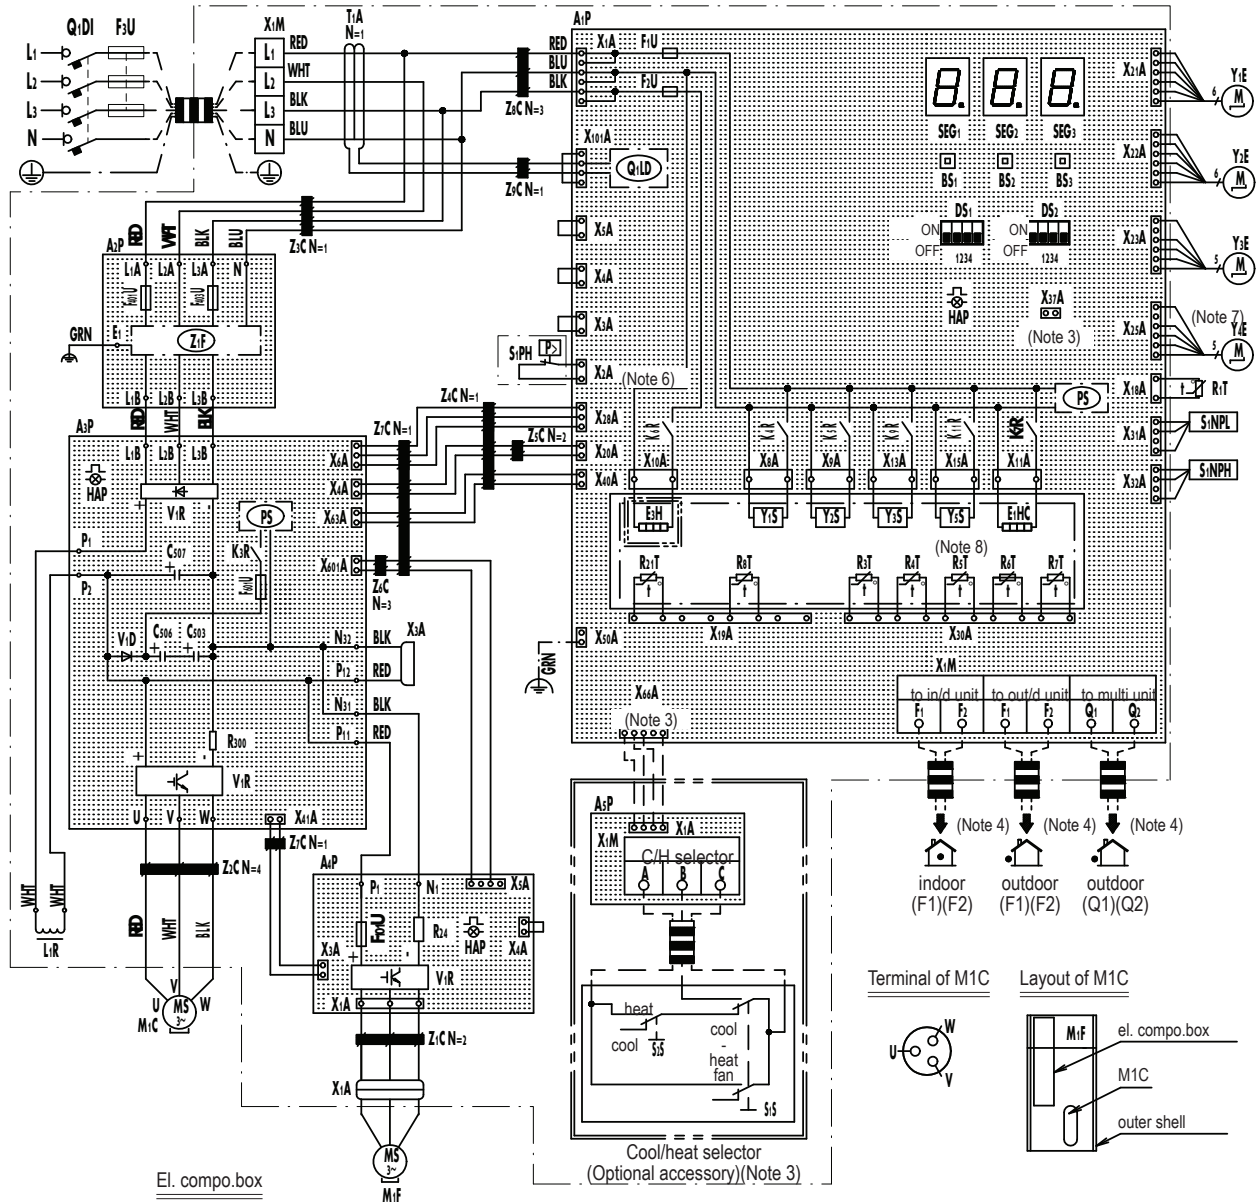


El. compo.box



Terminal of M1C



Layout of M1C



Cool/heat selector
(Optional accessory)(Note 3)

2D117534

9 Wiring diagrams

9 - 1 Wiring Diagrams - Three Phase

9

RXYQ8-12U
RXYTQ8UYF
RYYQ8-12U
RYMQ8-12U

A1P	Printed Circuit Board (Main)	R3T	Thermistor (Accumulator)
A2P	Printed Circuit Board (Noise Filter)	R4T	Thermistor (Heat Exc,Liq,Pipe)
A3P	Printed Circuit Board (Inv)	R5T	Thermistor (Subcool,Liq,Pipe)
A4P	Printed Circuit Board (Fan)	R6T	Thermistor (Heat Exc,Gas Pipe)
A5P	Printed Circuit Board (ABC I/P)(Option)	R7T	Thermistor (Heat Exc,Deicer)
BS1~3 (A1P)	Push Button Switch (Mode,Set,Return)	R8T	Thermistor (M1C body)
C503,C506,C507 (A3P)	Capacitor	R21T	Thermistor (M1C discharge)
DS1,DS2 (A1P)	DIP Switch	S1NPH	Pressure Sensor (High)
E1HC	Crankcase Heater	S1NPL	Pressure Sensor (Low)
E3H	Drainpan Heater (Option)	S1PH	Pressure Switch (Disch)
F1U,F2U (A1P)	Fuse (T,3,15A,250V)	SEG1~SEG3 (A1P)	7-Segment Display
F3U	Field Fuse	T1A	Current Sensor
F101U (A4P)	Fuse	V1D (A3P)	Diode
F401U,F403U (A2P)	Fuse	V1R (A3P,A4P)	Power Module
F601U (A3P)	Fuse	X*A	Connector
HAP (A1P,A3P, A4P)	Pilotlamp (Service Monitor-Green)	X1M (A1P)	Terminal Block (Control)
K3R (A3P)	Magnetic Relay	X1M (A5P)	Terminal Block (Power Supply)(Option)
K4R (A1P)	Magnetic Relay (Y1S)	Y1E	Electronic Expansion Valve(Main)
K5R (A1P)	Magnetic Relay (Y2S)	Y2E	Electronic Expansion Valve (Injection)
K6R (A1P)	Magnetic Relay (E3H)	Y3E	Electronic Expansion Valve (Refrigerant Jacket)
K7R (A1P)	Magnetic Relay (E1HC)	Y4E	Electronic Expansion Valve (Storage Vessel)
K9R (A1P)	Magnetic Relay (Y3S)	Y1S	Solenoid Valve (Main)
K11R (A1P)	Magnetic Relay (Y5S)	Y2S	Solenoid Valve (Accumulator Oil Return)
L1R	Reactor	Y3S	Solenoid Valve (Oil1)
M1C	Motor (Compressor)	Y5S	Solenoid Valve (Sub)
M1F	Motor (Fan)	Z*C	Noise Filter (Ferrite Core)
PS (A1P,A3P)	Switching Power Supply	Z*F (A2P)	Noise Filter (With Surge Absorber)
Q1DI	Field Earth Leakage Breaker	Connector For Optional Accessories	
Q1LD (A1P)	Field Earth Current Detector	X10A	Connector (Drainpan Heater)
R24 (A4P)	Resistor (Current Sensor)	X37A	Connector (Power Adapter)
R300 (A3P)	Resistor (Current Sensor)	X66A	Connector (Remote Switching Cool/Heat Selector)
R1T	Thermistor (Air)		

NOTES


1. This wiring diagram applies only to the outdoor unit.
2. :field wiring, :terminal block, :connector, :terminal, : protective earth (screw), : functional earth, : earth wiring, : field supply, : PCB, : switch box, : option
3. When using the optional adapter, refer to the installation manual of the optional adapter.
4. For connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2, outdoor-multi transmission Q1-Q2, refer to the installation manual.
5. How to use BS1~3 switch. Refer to "service precaution" label on el. compo. box cover.
6. When operating, don't shortcircuit the protection devices (S1PH).
7. Only for RYYQ model.
8. Only for RYYQ/RYMQ model.
9. Colors: BLK: Black, RED: Red, BLU: Blue, WHT: White, GRN: Green.

2D117534

9 Wiring diagrams

9 - 1 Wiring Diagrams - Three Phase

RXYQ14-20U
RYYQ14-20U
RYMQ14-20U

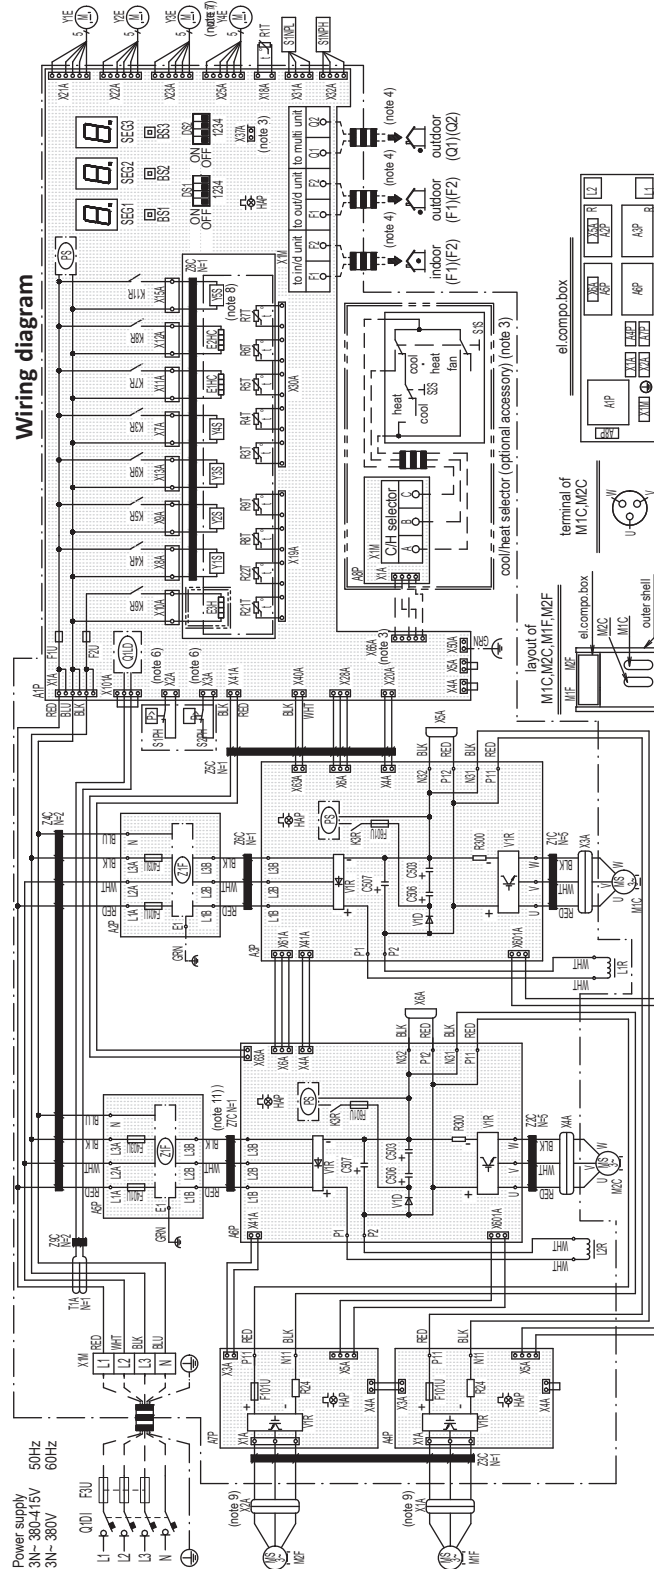

A1P	Printed circuit board (main)
A2P, A5P	Printed circuit board (noise filter)
A3P, A6P	Printed circuit board (inv)
A4P, A7P	Printed circuit board (fan)
A8P	Printed circuit board (ABC I/P)
BS1-3 (A1P)	Push button switch (mode, set, return)
C503, C506, C507 (A3P, A6P)	Capacitor
DS1, DS2 (A1P)	Dip switch S1PH,
E1HC, E2HC	Crankcase heater
E3H	Drainpan heater (option)
F1U, F2U (A1P)	Fuse (T, 3, 15A, 250V)
F3U	Field fuse
F101U (A4P, A7P)	Fuse
F401U, F403U (A2P, A5P)	Fuse
F601U (A3P, A6P)	Fuse
HAP (A1P, A3P, A4P, A6P, A7P)	Pilotlamp (service monitor-green)
K3R (A3P, A6P)	Magnetic relay
K3R (A1P)	Magnetic relay (Y4S)
K4R (A1P)	Magnetic relay (Y1S)
K5R (A1P)	Magnetic relay (Y2S)
K6R (A1P)	Magnetic relay (E3H)
K7R (A1P)	Magnetic relay (E1HC)
K8R (A1P)	Magnetic relay (E2HC)
K9R (A1P)	Magnetic relay (Y3S)
K11R (A1P)	Magnetic relay (Y5S)
L1R, L2R	Reactor
M1C, M2C	Motor (compressor)
M1F, M2F	Motor (fan)
PS (A1P, A3P, A6P)	Switching power supply
Q1DI	Field earth leakage breaker
Q1LD (A1P)	Field earth current detector
R24 (A4P, A7P)	Resistor (current sensor)
R300 (A3P, A6P)	Resistor (current sensor)
R1T	Thermistor (air)
R3T	Thermistor (accumulator)
R4T	Thermistor (heat exc, liq, pipe)
R5T	Thermistor (subcool, liq, pipe)
R6T	Thermistor (heat exc, gas pipe)
R7T	Thermistor (heat exc, deicer)
R8T, R9T	Thermistor (M1C, M2C body)
R21T, R22T	Thermistor (M1C, M2C discharge)
S1NPH	Pressure sensor (high)
S1NPL	Pressure sensor (low)
S1PH, S2PH	Pressure switch (disch)
SEG1-SEG3 (A1P)	7-segment display
T1A	Current sensor
V1D (A3P, A6P)	Diode
V1R (A3P, A4P, A6P, A7P)	Power module
X*A	Connector
X1M (A1P)	Terminal block (control)
X1M (A8P)	Terminal block (power supply)
Y1E	Electronic expansion valve (main)
Y2E	Electronic expansion valve (injection)
Y3E	Electronic expansion valve (refrigerant jacket)
Y4E	Electronic expansion valve (storage vessel (note 7))
Y1S	Solenoid valve (main)
Y2S	Solenoid valve (accumulator oil return)
Y3S	Solenoid valve (oil1)
Y4S	Solenoid valve (oil2)
Y5S	Solenoid valve (sub) (note 8)
Z*C	Noise filter (ferrite core)
Z*F (A2P, A5P)	Noise filter (with surge absorber)
Connector for optional accessories	
X10A	Connector (drainpan heater)
X37A	Connector (power adapter)
X66A	Connector (remote switching)
	Cool/heat selector

NOTES

- This wiring diagram applies only to the outdoor unit.
- Field wiring, terminal block, connector, terminal, protective earth (screw), functional earth, earth wiring, field supply, pcb, switch box, option
- When using the optional adapter, refer to the installation manual of the optional adapter.
- For connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2, outdoor-multi transmission Q1-Q2, refer to the installation manual.
- How to use BS1-3 switch. Refer to "service precaution" label on el. Compo. Box cover.
- When operating, don't shortcircuit the protection devices (S1PH, S2PH)
- Only for RYYQ model.
- Only for RYYQ/RYMQ model.
- Connector X1A (M1F) is red, connector X2A (M2F) is white.
- Colors: BLK:black, RED:red, BLU:blue, WHT:white, GRN:green.
- Only for 14,16 class

2D117536C


10 External connection diagrams

10 - 1 External Connection Diagrams

RXYQQ8-20U
RXYQ8-20U
RXYTQ8-16UYF
RYYQ8-20U
RYMQ8-20U

Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
2. Use copper conductors only
3. For details, refer to the wiring diagram attached to the outdoor unit.
4. Install a circuit breaker for safety.
5. All field wiring and components must be provided by an authorised electrician.
6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
9. Install a main switch to control the multiple power sources that the various components of the system make use of.
10. The capacity of UNIT1 must be larger than that of UNIT2 when the power source is connected in series between the units.
 The capacity of UNIT 2 must be larger than that of UNIT3 when the power source is connected in series between the units.
11. If there exists the possibility of reversed phase, loose phase or momentary blackout, or if the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
 Running the product in reversed phase may break the compressor and other parts.
12. Install an earth leakage circuit breaker.

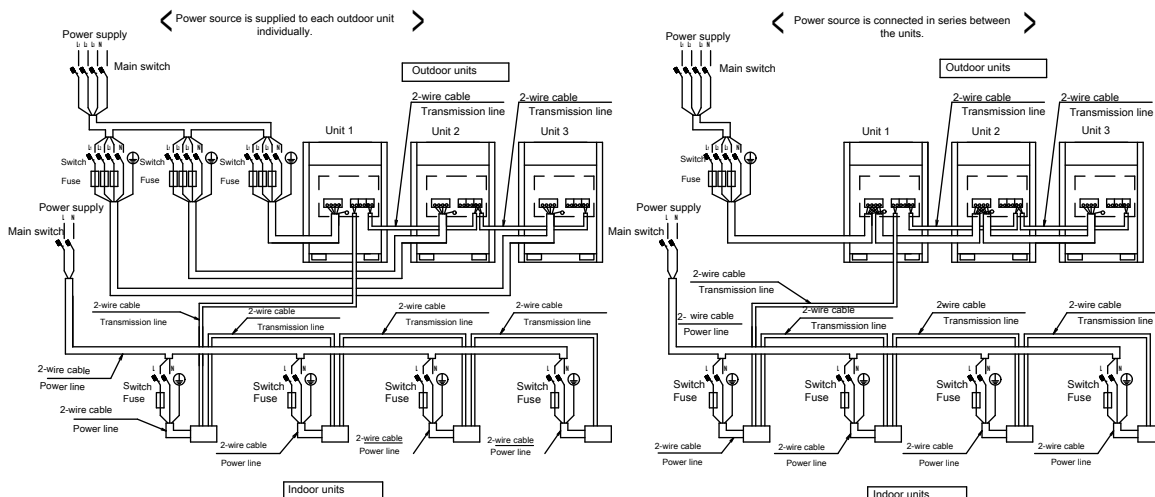


3D119200

RXYQQ8-20U
RXYQ8-20U
RXYTQ8-16U
RYYQ8-20U
RYMQ8-26U

Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
2. Use copper conductors only
3. For details, refer to the wiring diagram attached to the outdoor unit.
4. Install a circuit breaker for safety.
5. All field wiring and components must be provided by an authorised electrician.
6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
9. Install a main switch to control the multiple power sources that the various components of the system make use of.
10. The capacity of UNIT1 must be larger than that of UNIT2 when the power source is connected in series between the units.
11. If there exists the possibility of reversed phase, loose phase or momentary blackout, or if the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
 Running the product in reversed phase may break the compressor and other parts.
12. Install an earth leakage circuit breaker.

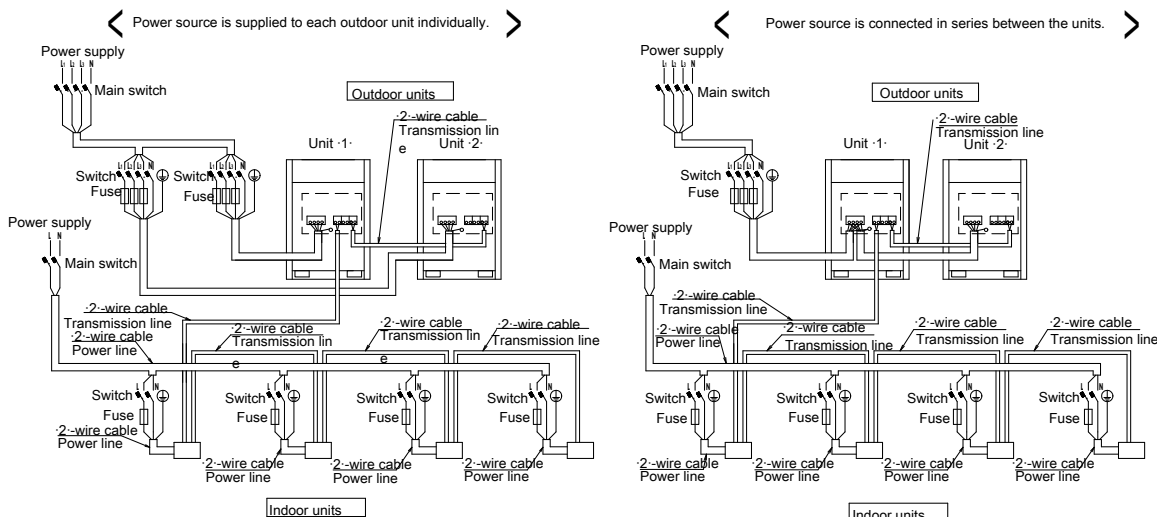


3D119316

10 External connection diagrams

10 - 1 External Connection Diagrams

RXYQQ8-20U
RXYQ8-20U
RYYQ8-20U
RYMQ8-20U
RXYTQ8-16UYF

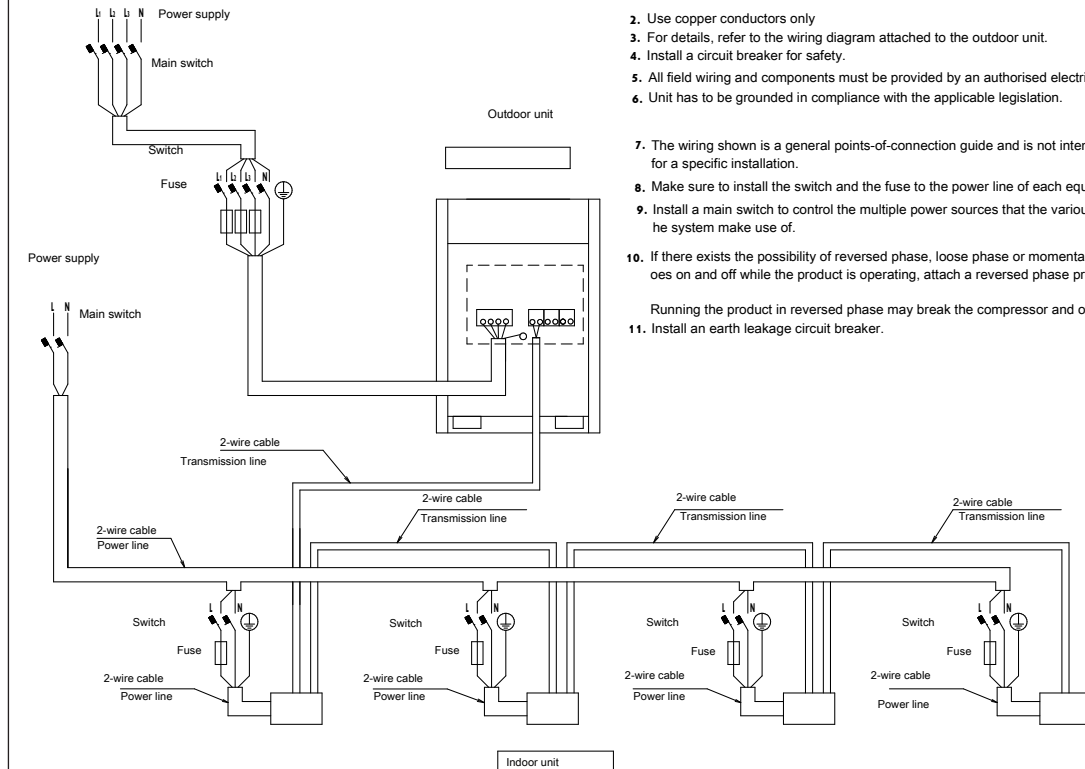

Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
2. Use copper conductors only
3. For details, refer to the wiring diagram attached to the outdoor unit.
4. Install a circuit breaker for safety.
5. All field wiring and components must be provided by an authorised electrician.
6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
9. Install a main switch to control the multiple power sources that the various components of the system make use of.
10. If there exists the possibility of reversed phase, loose phase or momentary blackout, or if the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.
11. Install an earth leakage circuit breaker.


3D119317

11 Sound data

11 - 1 Sound Power Spectrum

11

REMQ5U
REYQ8U
RXYQQ8U
RXYQ8U
RXYTQ8UYF
RYYQ8U
RYMQ8U

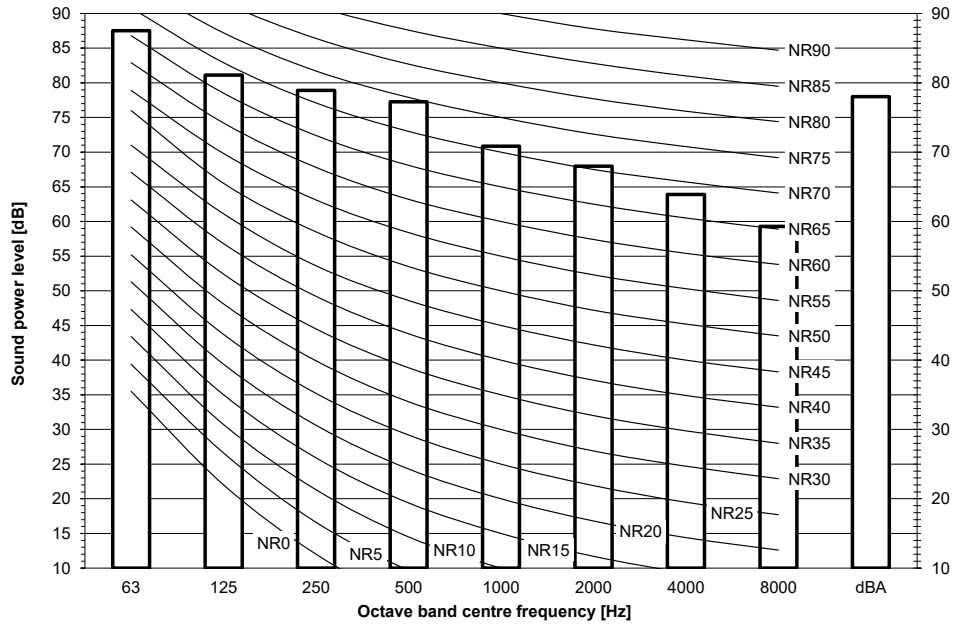


Notes

dBA = A-weighted sound power level (A scale according to IEC).
Reference acoustic intensity 0dB = $10E-6\mu W/m^2$
Measured according to ISO 3744

3D119528

REYQ10U
RXYQQ10U
RXYQ10U
RYYQ10U
RYMQ10U

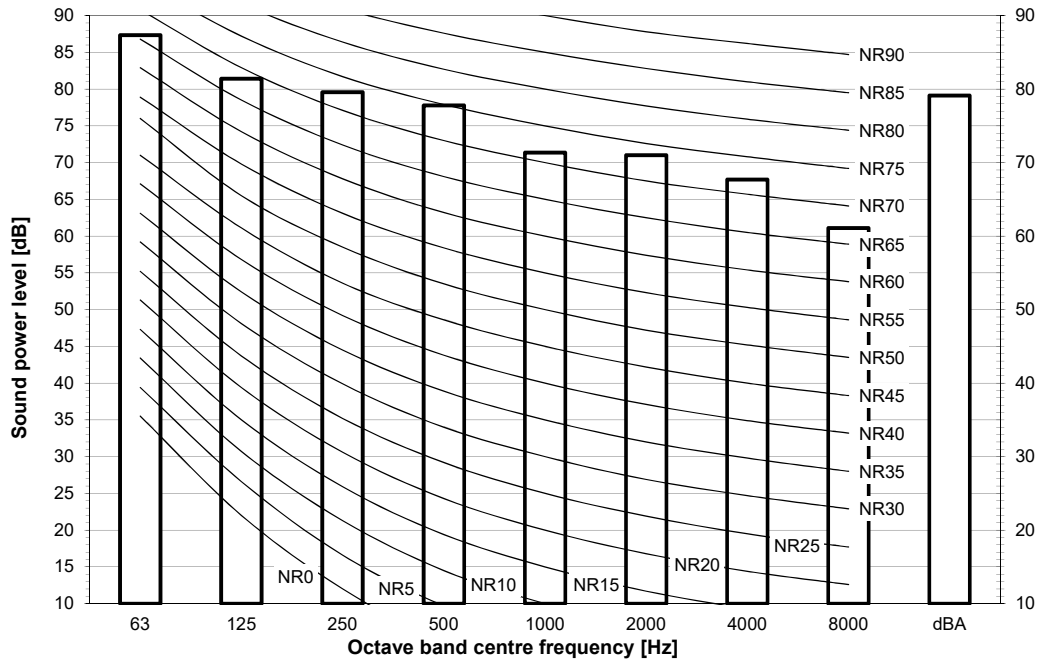

Notes


dBA = A-weighted sound power level (A scale according to IEC).
Reference acoustic intensity 0dB = $10E-6\mu W/m^2$
Measured according to ISO 3744

3D119529

11 Sound data

11 - 1 Sound Power Spectrum

REYQ12U
RXYQ12U
RXYQ12U
RYYQ12U
RYMQ12U

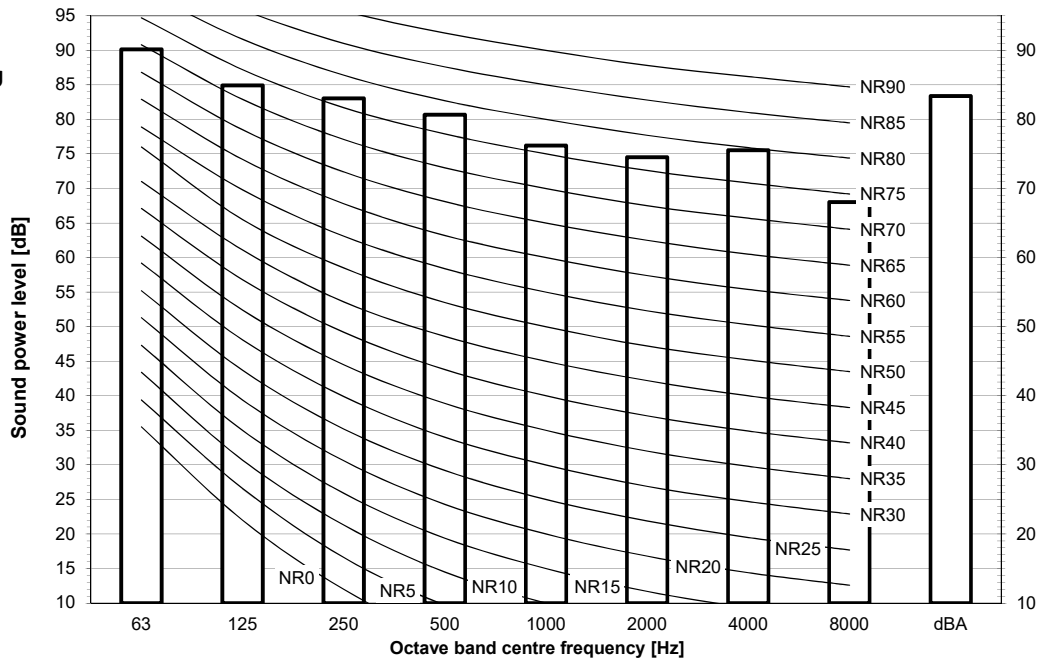

Notes


dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = $10E-6\mu W/m^2$

Measured according to ISO 3744

3D119530

REYQ14U
RXYQ14U
RXYQ14U
RYYQ14U
RYMQ14U

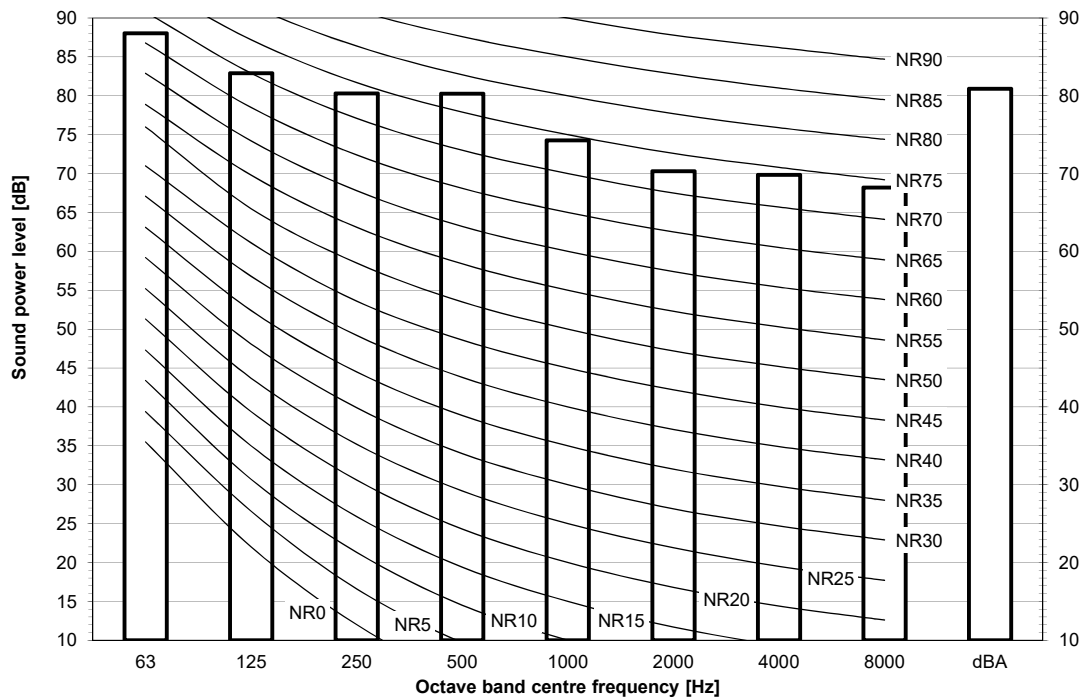

Notes

dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = $10E-6\mu W/m^2$


Measured according to ISO 3744

3D119531

11 Sound data

11 - 1 Sound Power Spectrum

REYQ16U
RXYQQ16U
RXYQ16U
RYYQ16U
RYMQ16U

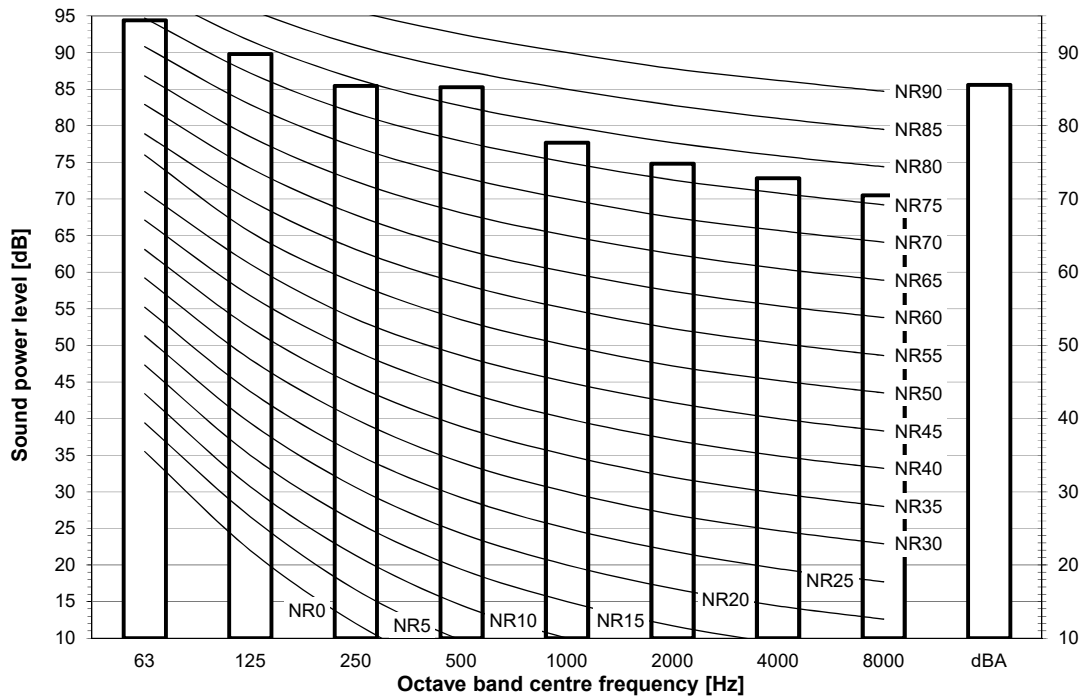

Notes


dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = $10E-6\mu W/m^2$

Measured according to ISO 3744

3D119532

REYQ18U
RXYQQ18U
RXYQ18U
RYYQ18U
RYMQ18U

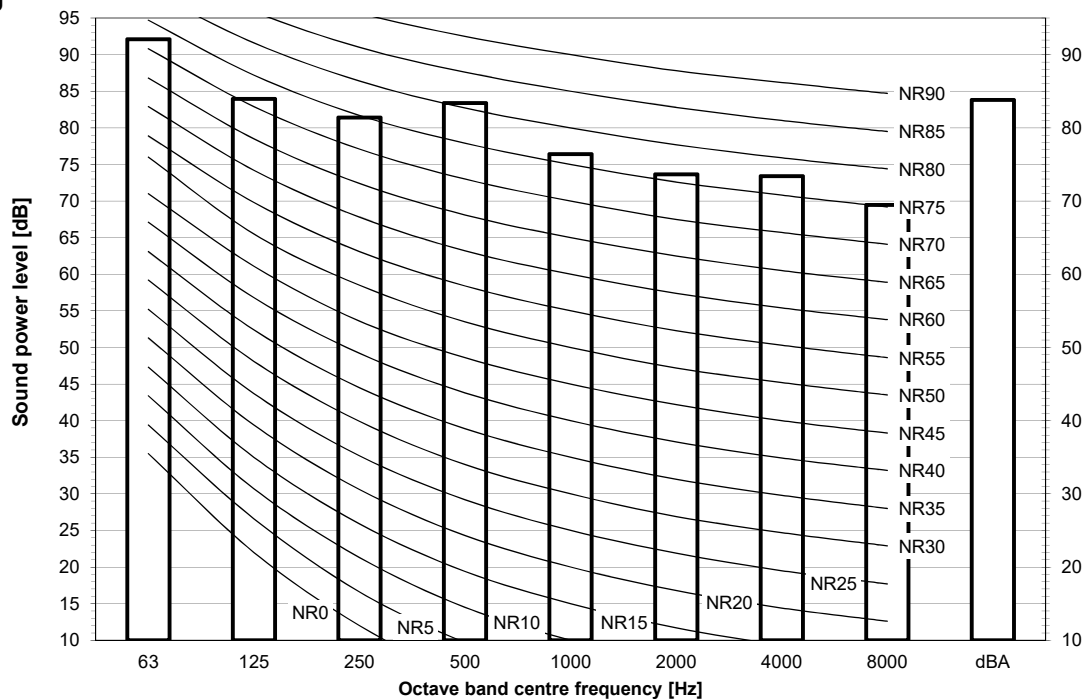

Notes

dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = $10E-6\mu W/m^2$


Measured according to ISO 3744

3D119533

11 Sound data

11 - 1 Sound Power Spectrum

REYQ20U
RXYQQ20U
RXYQ20U
RYYQ20U
RYMQ20U

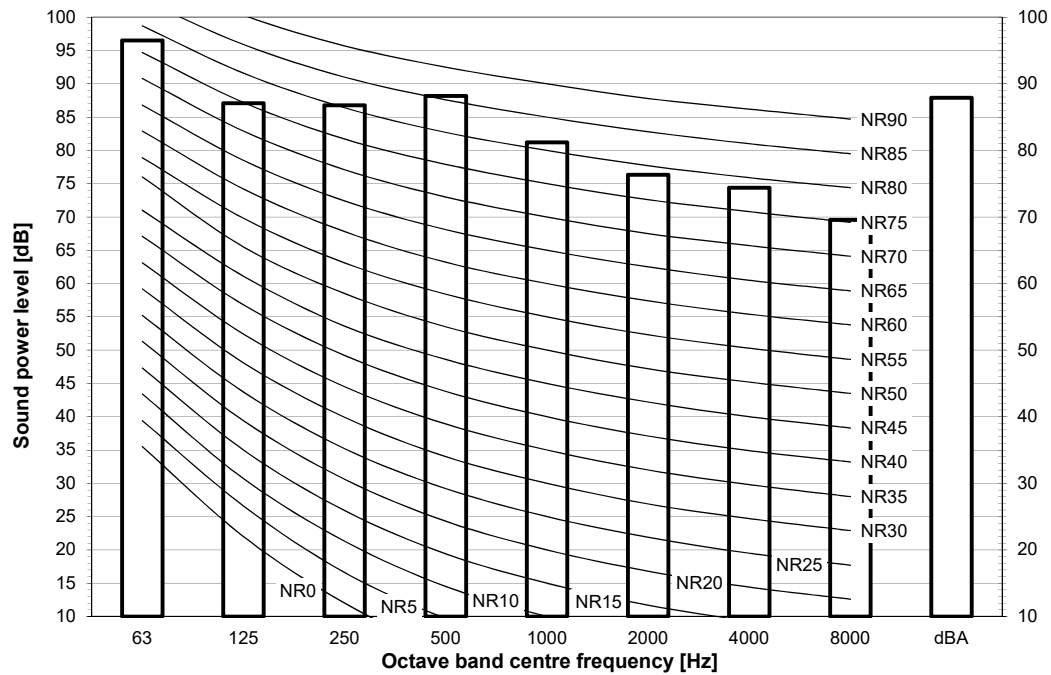

Notes

dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = 10^{-6} W/m^2

Measured according to ISO 3744


3D119534

11 Sound data

11 - 2 Sound Pressure Spectrum


11

REMQ5U
REYQ8U
RXYQQ8U
RXYQ8U
RXYTQ8UYF
RYYQ8U
RYMQ8U

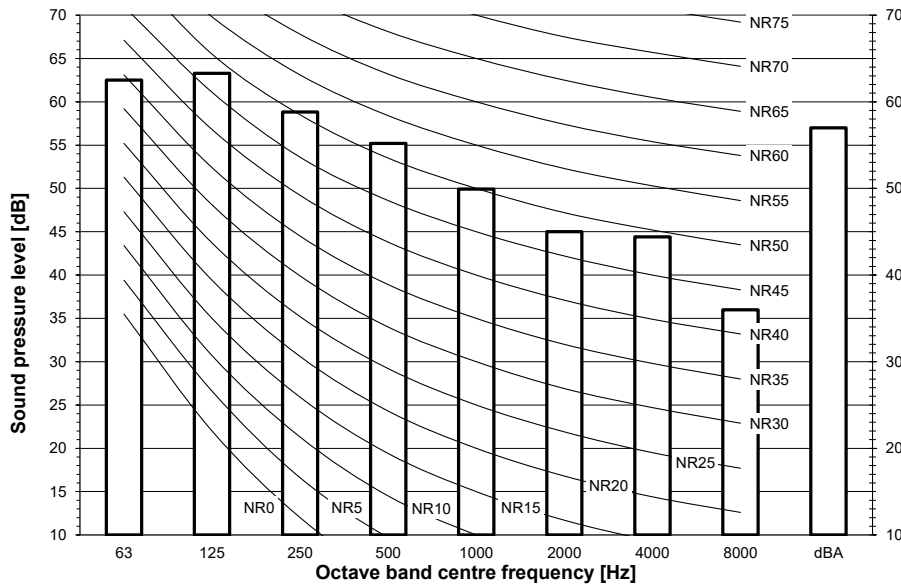


Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

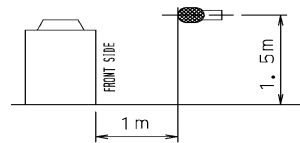


3D119521

REYQ10U
RXYQQ10U
RXYQ10U
RYYQ10U
RYMQ10U

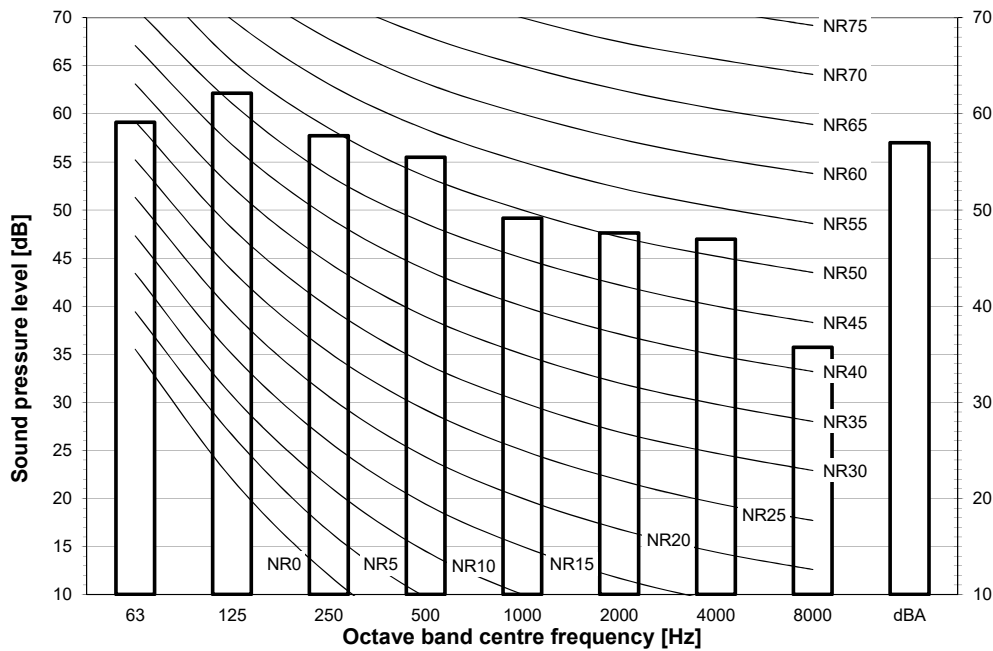

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

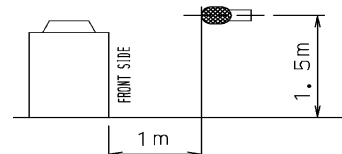


3D119522

11 Sound data


11 - 2 Sound Pressure Spectrum

REYQ12U
RXYQQ12U
RXYQ12U
RYYQ12U
RYMQ12U

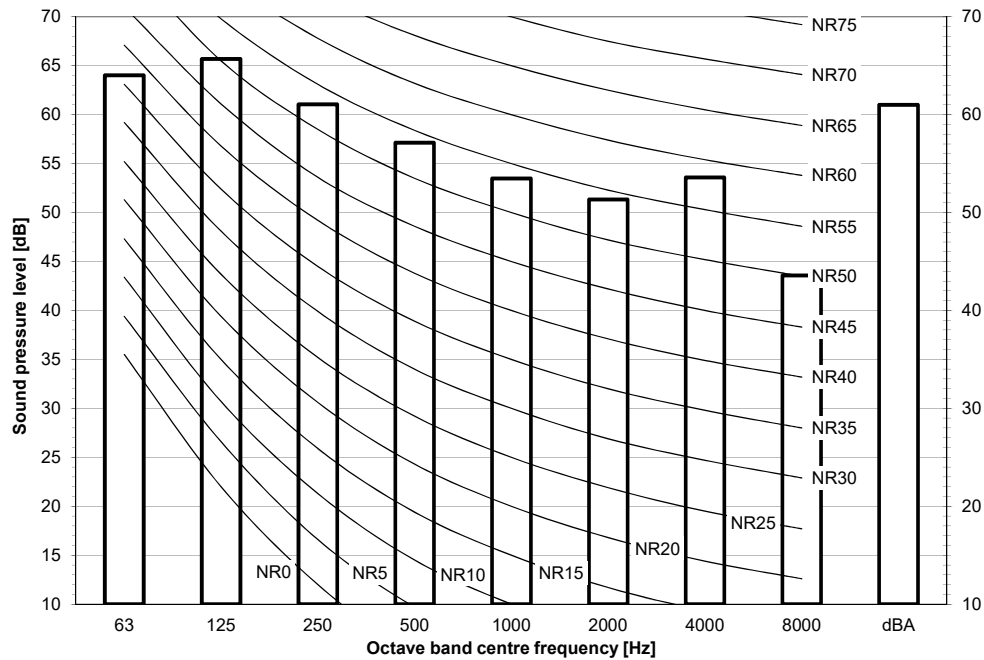


Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 µPa

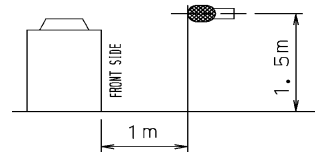


3D119523

REYQ14U
RXYQQ14U
RXYQ14U
RYYQ14U
RYMQ14U

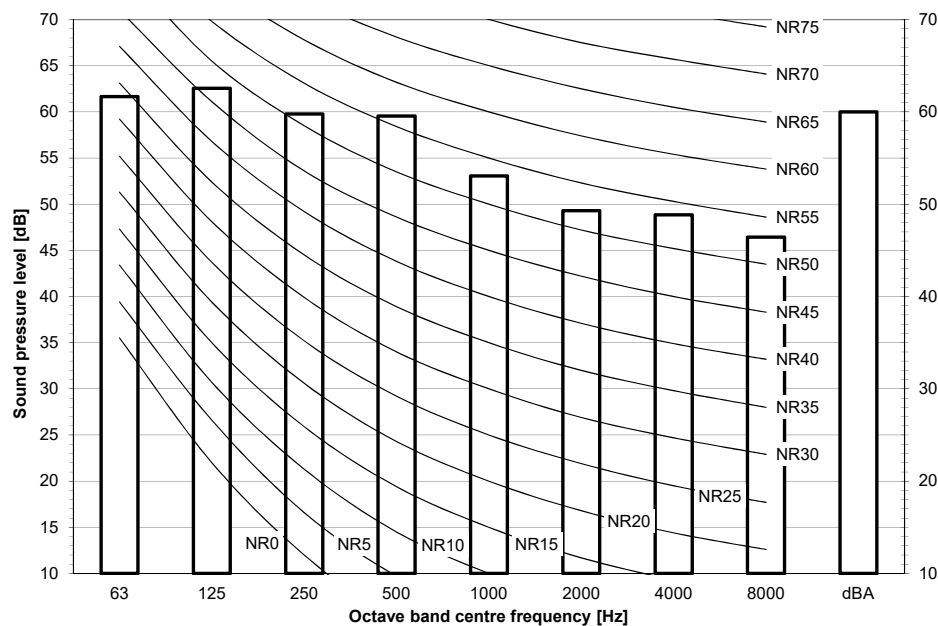

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 µPa

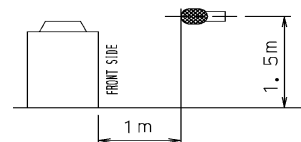


3D119524

11 Sound data

11 - 2 Sound Pressure Spectrum


11

REYQ16U
RXYQQ16U
RXYQ16U
RYYQ16U
RYMQ16U

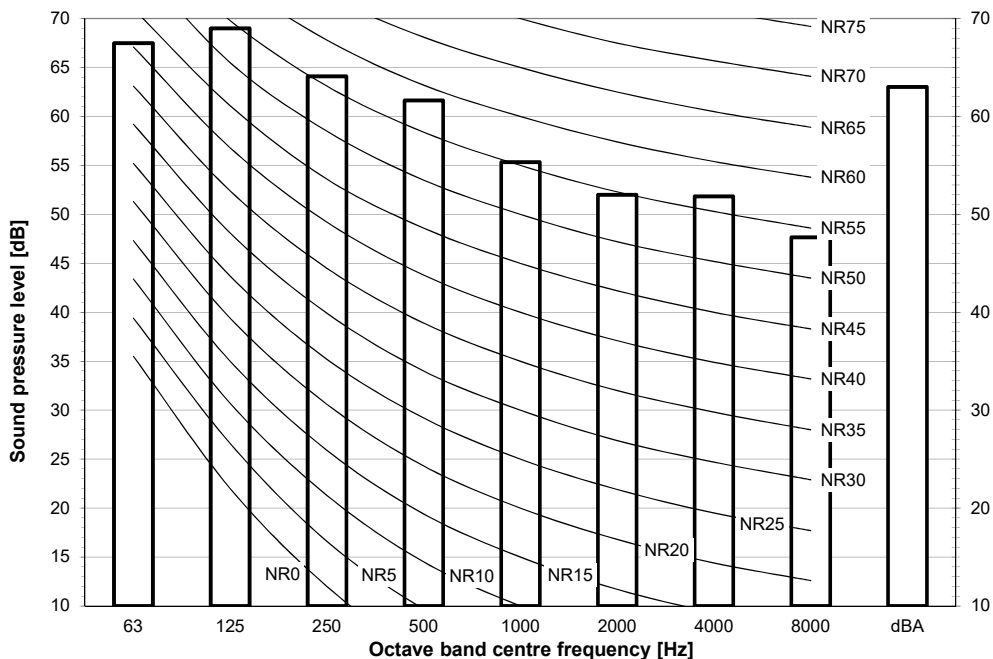


Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

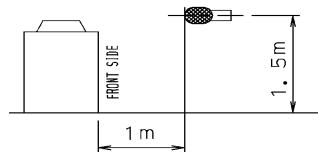


3D119525

REYQ18U
RXYQQ18U
RXYQ18U
RYYQ18U
RYMQ18U

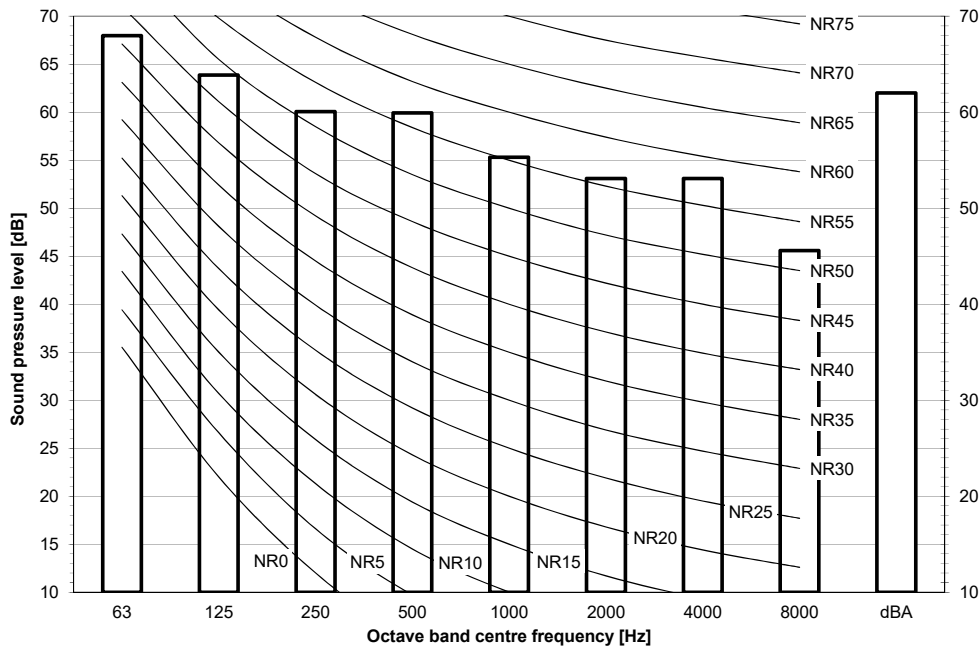

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

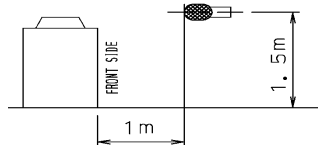


3D119526

11 Sound data

11 - 2 Sound Pressure Spectrum

REYQ20U
RXYQQ20U
RXYQ20U
RYYQ20U
RYMQ20U

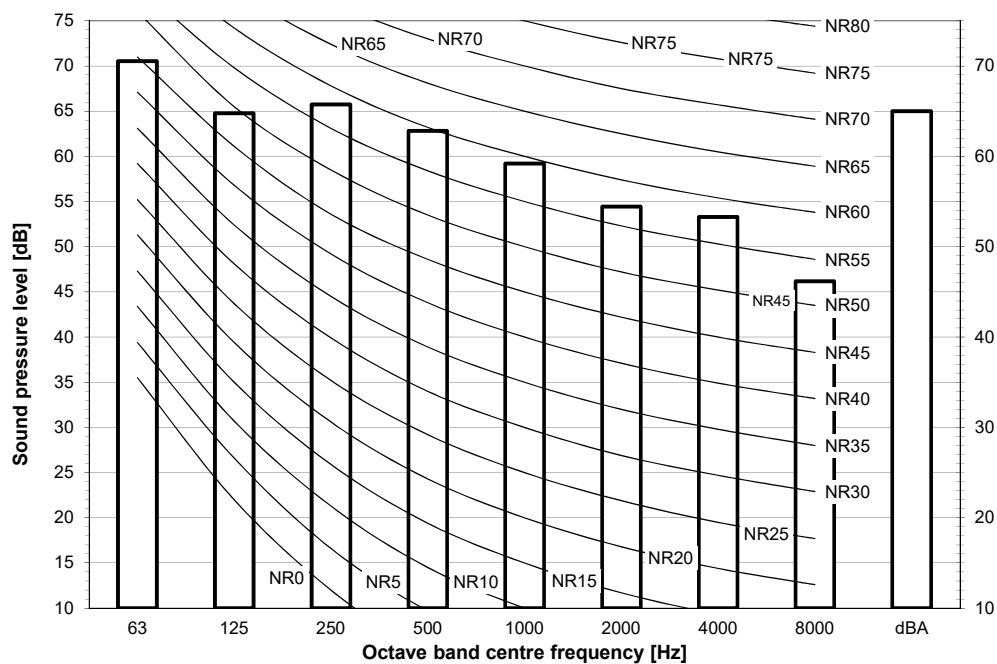


Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).

Reference acoustic pressure 0 dB = 20 μ Pa

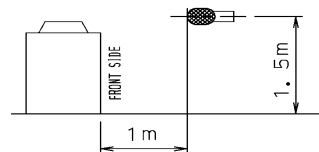

3D119527

11 Sound data

11 - 3 Sound Pressure Spectrum Quiet Mode Level 1

REMQ5U

REYQ8-12U


RXYQQ8-12U

RXYQ8-12U

RXYTQ8UYF

RYY8-12U

RYMQ8-12U

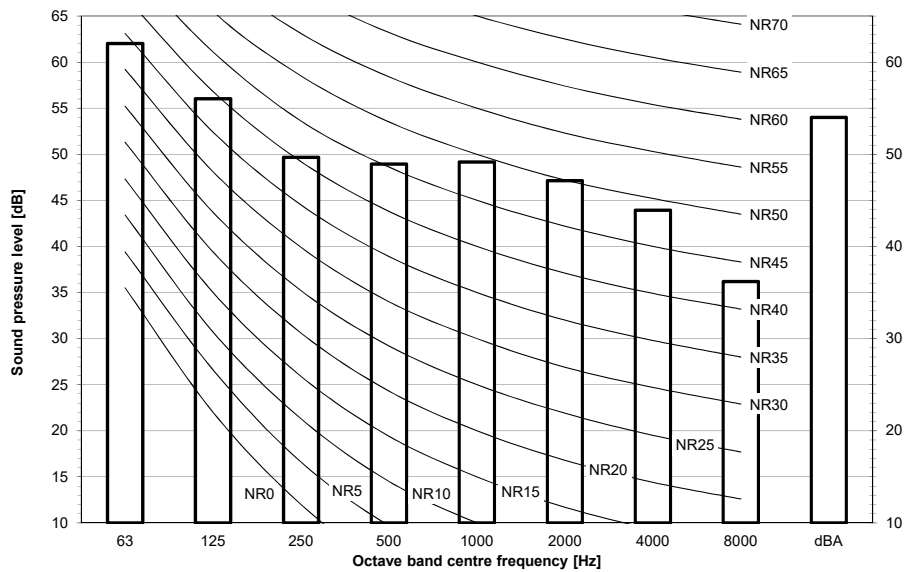

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119535

REYQ14-16U


RXYQQ14-16U

RXYQ14-16U

RXYTQ14-16UYF

RYYQ14-16U

RYMQ14-16U

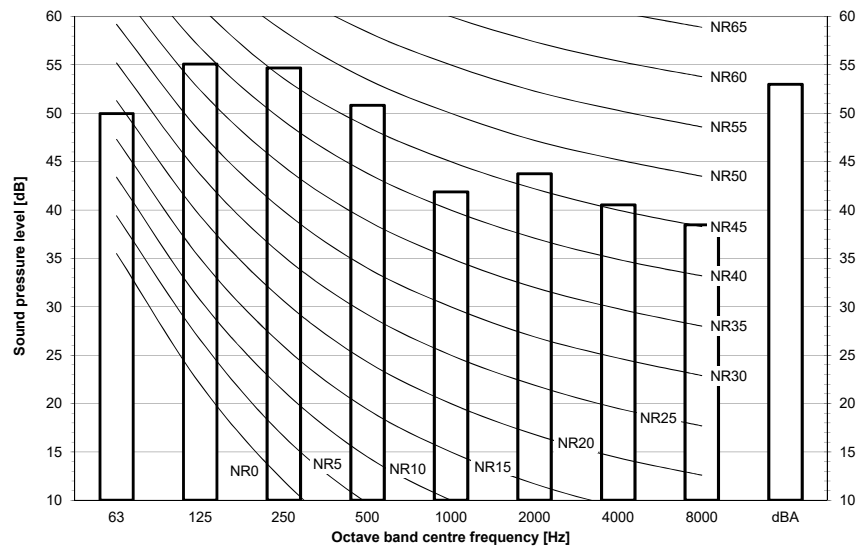

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119538


11 Sound data

11 - 3 Sound Pressure Spectrum Quiet Mode Level 1

REYQ18-20U
RXYQQ18-20U
RXYQ18-20U
RYYQ18-20U
RYMQ18-20U

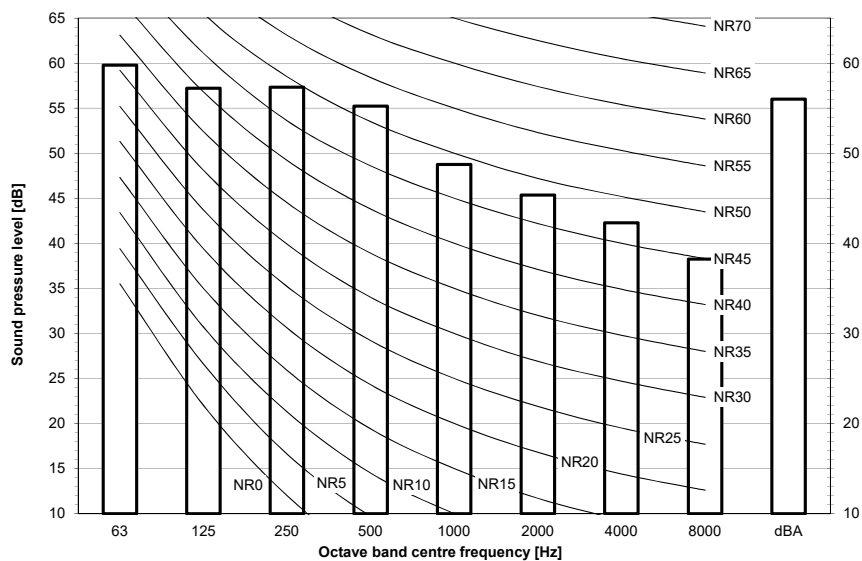

Notes
Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 µPa
Data is valid under the following conditions
Cooling operation
Outdoor Ta: 35°C
Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119541

11 Sound data


11 - 4 Sound Pressure Spectrum Quiet Mode Level 2

11

REMQ5U
REYQ8-12U
RXYQ8-12U
RXYTQ8UYF
RYYQ8-12U
RYMQ8-12U

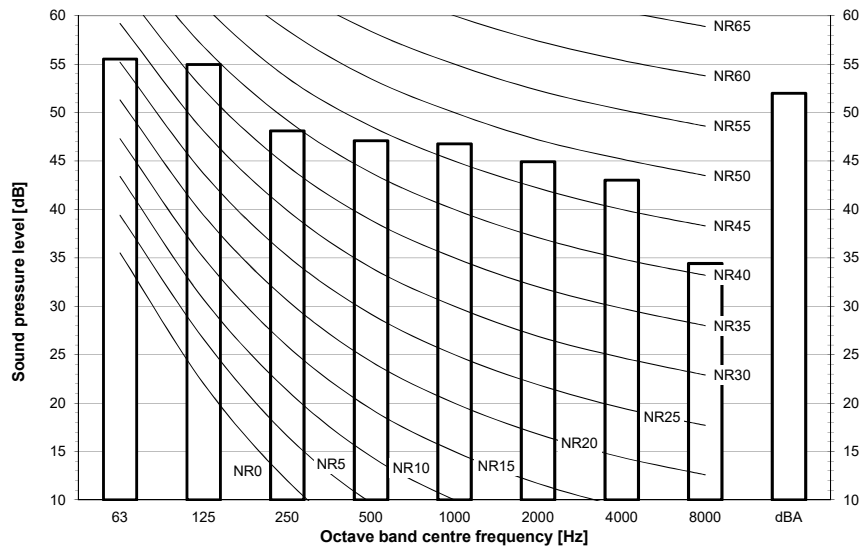


Notes
Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 µPa
Data is valid under the following conditions
Cooling operation
Outdoor Ta: 35°C
Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119536

REYQ14-16U
RXYQ14-16U
RXYTQ14-16UYF
RYYQ14-16U
RYMQ14-16U

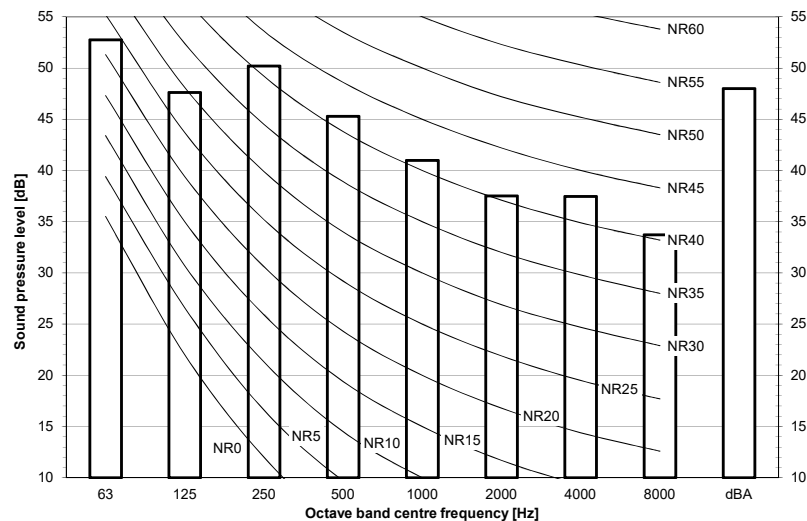

Notes
Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 µPa
Data is valid under the following conditions
Cooling operation
Outdoor Ta: 35°C
Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119539

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode Level 2

REYQ18-20U
RXYQQ18-20U
RXYQ18-20U
RYYQ18-20U
RYMQ18-20U

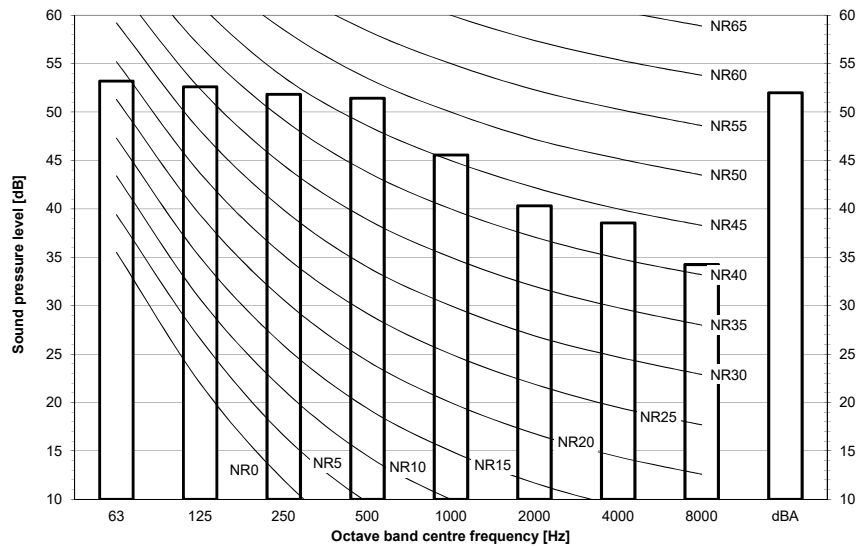

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)

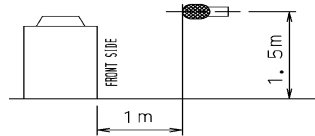


3D119542

11 Sound data

11 - 5 Sound Pressure Spectrum Quiet Mode Level 3


11

REMQ5U
REYQ8-12U
RXYQ8-12U
RXYTQ8UYF
RYYQ8-12U
RYMQ8-12U

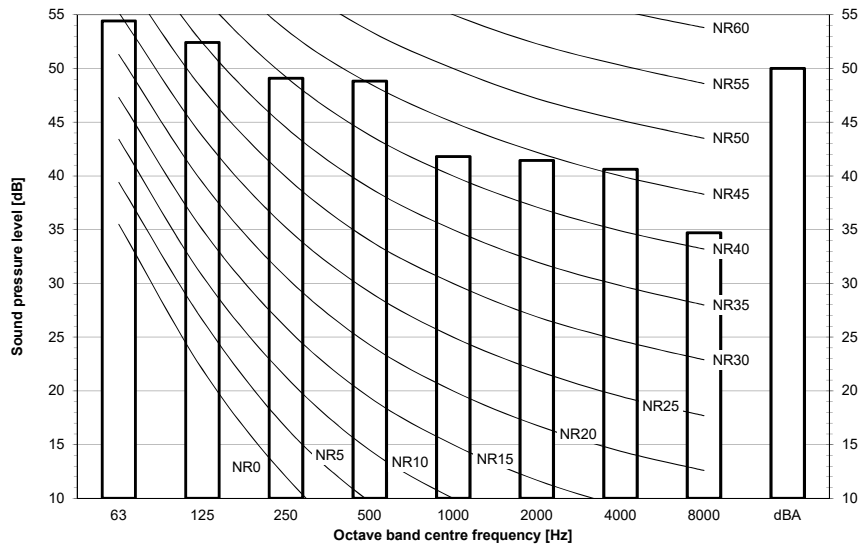


Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa
Data is valid under the following conditions
Cooling operation
Outdoor Ta: 35°C
Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119537

REYQ14-16U
RXYQ14-16U
RXYTQ14-16UYF
RYYQ14-16U
RYMQ14-16U

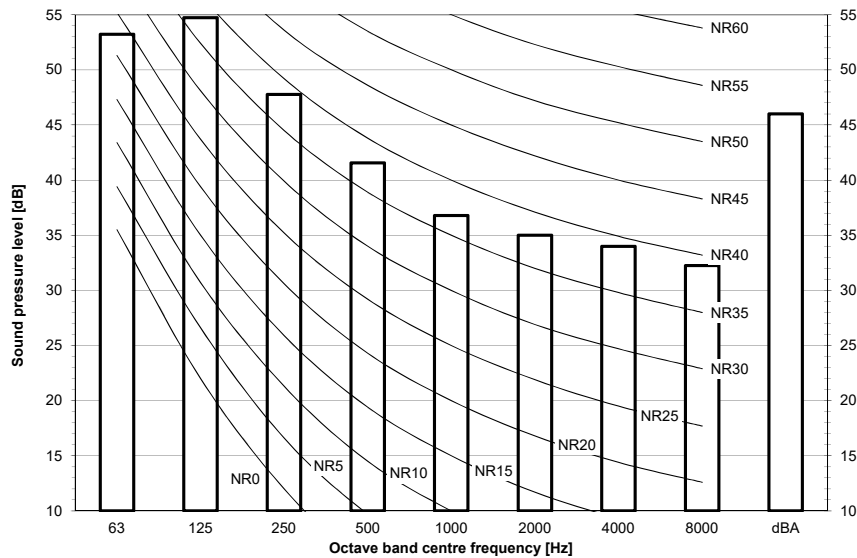

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa
Data is valid under the following conditions
Cooling operation
Outdoor Ta: 35°C
Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119540

11 Sound data

11 - 5 Sound Pressure Spectrum Quiet Mode Level 3


REYQ18-20U

RXYQQ18-20U

RXYQ18-20U

RYYQ18-20U

RYMQ18-20U

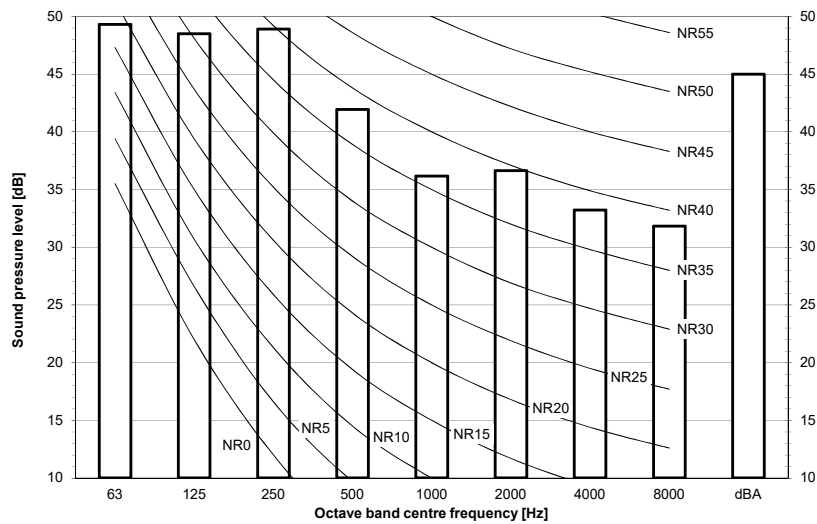

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119543


12 Installation

12 - 1 Installation Method


RXYQ-U
RYYQ-U
RYMQ-U

12

For single unit installation For installation in rows

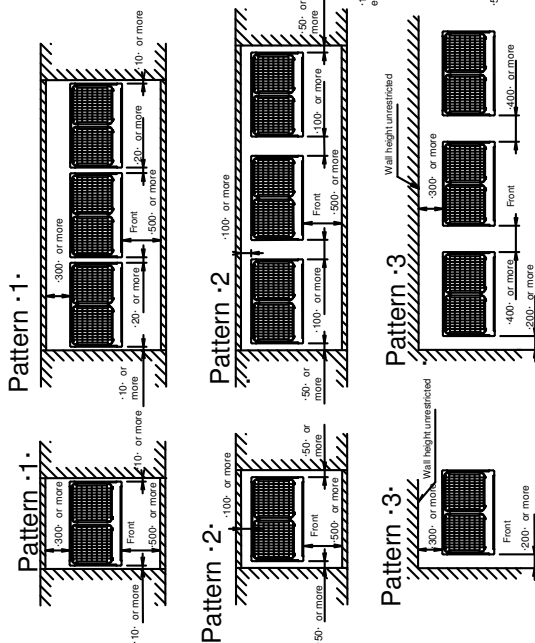

For centralised group layout

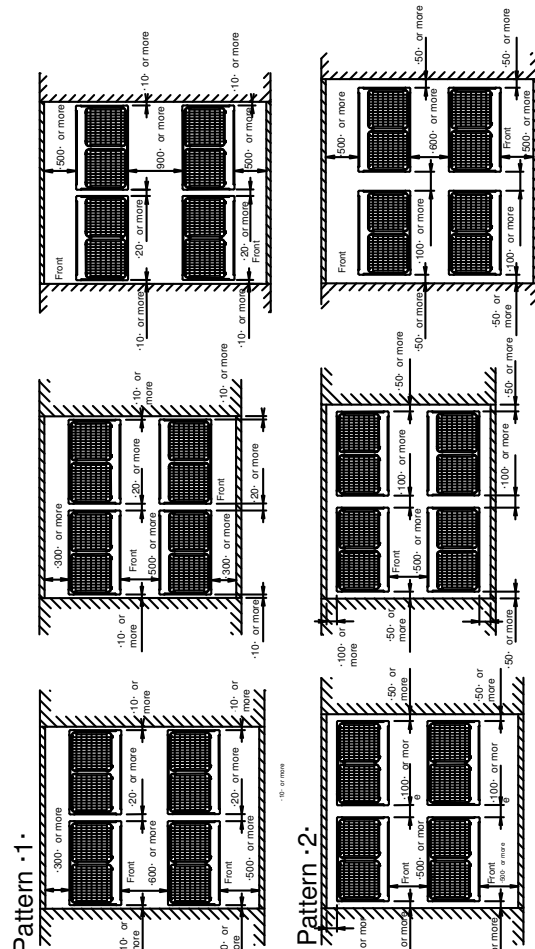

Notes

1. Height of the walls in case of patterns ·1· and ·2·:

Front: ·1500·mm

Suction side: ·500·mm

Side: height unrestricted

The installation space shown on this drawing is based on cooling operation at ·35·°C (outdoor temperature).

When the design outdoor ambient temperature exceeds 35°C or the load exceeds maximum ability of much generation load of heat in all outdoor unit, make sure the suction-side space is broader than the space shown on this drawing.

2. If the walls are higher than mentioned above, then additional service space is needed:

- suction side: service space + h1/2


- front side: service space + h2/2

3. When installing the units, select the pattern that best fits the available space.

Always keep in mind to leave sufficient space for a person to pass between unit and wall and for the air to circulate freely.

Provide sufficient space at the front to connect refrigerant piping (comfortably).

4. If more units are to be installed than are catered for in the above patterns, your layout should take into account of the possibility of short circuits.





3D118467A

12 Installation



12 - 2 Fixation and Foundation of Units

RYYQ-U
RYMQ-U

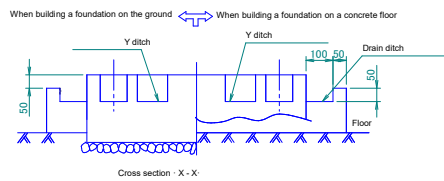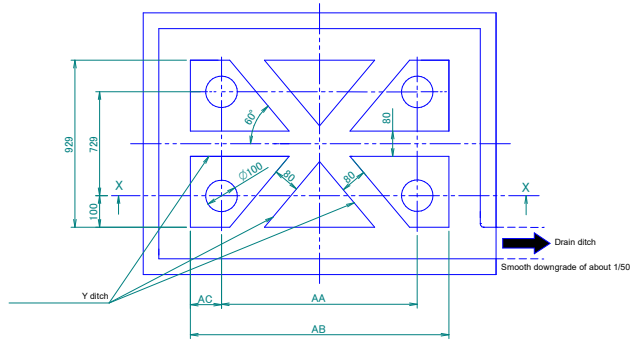

Notes

1. Provide a drain ditch around the foundation to drain water from the installation area.
2. The surface has to be finished with mortar. The corner edges have to be chamfered.
3. Build the foundation on a concrete floor or, if not possible, make sure the foundation surface has a rough finish.
4. Use a cement/sand/gravel ratio of 1/2/4 for the concrete, and a diameter of 10 mm for the reinforcement bars (approximately, 300mm intervals).
5. When installing the equipment on a roof, make sure to check the strength of the floor and take adequate water proofing measures.

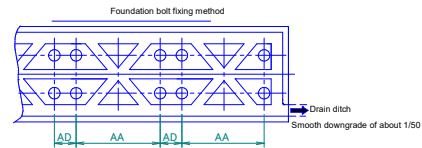

For multi-unit installation

Model	AA	AB	AC	AD
RYYQ8-12U RYMQ8-12U RXYQ8-12U RXYQ8-12U REMO8T/REYQ8-12U RXYT08U REMASA*/REYA8-12A* RYMASA/RXYA8-12A	766	992	113	185
RYYQ14-20U RYMQ14-20U RXYQ14-20U RXYQ14-20U REYQ14-20U RXYT010-16U REYA14-20A* RXYA14-20A	1076	1076		

3D118459C

12 Installation

12 - 3 Refrigerant Pipe Selection

12

RYYQ-U
RYMQ-U

VRV4
Heat pump
Piping restrictions ·1/3·

For the reference drawing,
see page ·2/3·.

	Maximum piping length			Maximum height difference ⁽³⁾			Total piping length
	Longest pipe (A+[B,G,E,J]) Actual / (Equivalent)	After first branch (B,G,E,J) Actual	After first branch (for multi-outdoor) (D) Actual / (Equivalent)	Indoor-to-outdoor (H1) Outdoor above indoor / (indoor above outdoor)	Indoor-to-indoor (H2)	Outdoor-to-outdoor (H3)	
Standard							
-VRV DX- indoor units only	165/(190)m ⁽⁸⁾	40m ⁽¹⁾	10/(13)m	50/(40)m ⁽⁸⁾	30m	5m	1000m
Standard multi-combination							
All multi-outdoor-unit combinations except	135/(160)m ⁽⁸⁾	40m ⁽¹⁾	10/(13)m	50/(40)m ⁽⁸⁾	30m	5m	500m
-Hydrobox- connection	135/(160)m ⁽⁸⁾	40m	10/(13)m	50/(40)m	15m	5m	300-500m ⁽³⁾
-RA- connection	100/(120)m ⁽⁸⁾	50m ⁽²⁾	-	50/(40)m	15m	-	250m
-AHU- connection	Pair	50/(55)m ⁽⁴⁾	40m	40/(40)m	-	5m	150m ⁽⁹⁾
	Multi ⁽⁶⁾	165/(190)m ⁽⁸⁾	40m	40/(40)m	15m	5m	1000m
	Mix ⁽⁷⁾	165/(190)m ⁽⁸⁾	40m	40/(40)m	15m	5m	1000m

Remark


For standard multi-outdoor-unit combinations, see ·3D079534·.

- (1) If all conditions below are met, the limitation can be extended up to 90 m
 - a. The piping length between all indoor units and the nearest branch kit is ≤ 40m.
 - b. It is necessary to increase the size of the gas and liquid piping.
If the increased pipe size is larger than the pipe size of the main pipe, also increase the size of the main pipe.
 - c. When the piping size is increased, the piping length has to be counted as double.
The total piping length has to be within limitations.
- d. The piping length difference between the nearest indoor unit from the first branch to the outdoor unit and the farthest indoor unit to the outdoor unit is ≤ 40-m.
- (2) If the piping length between the first branch and the ·BP· box or ·VRV· indoor unit is more than ·20·m, increase the length of the gas and liquid piping between the first branch and the ·BP· box or ·VRV· indoor unit.
- (3) An extension to up to ·90· m is possible without an additional option kit. Respect the following conditions:
 - > If the outdoor units are positioned higher than the indoor units:
 - a. Size up the liquid piping
 - b. A dedicated setting on the outdoor unit is required.
 - > If the outdoor units are positioned lower than the indoor units:
 - a. 40~60m Minimum connection ratio: ·80%·
60~65m Minimum connection ratio: ·90%·
65~80m Minimum connection ratio: ·100%·
80~90m Minimum connection ratio: ·110%·
 - b. Size up the liquid piping
- (4) A dedicated setting on the outdoor unit is required.
- (5) The allowable minimum length is ·5· m.
- (6) In case of multi-outdoor-unit combinations.
- (7) Multiple air handling units (AHU)(·EKEV· + ·EKEQ· kits) or (AHU)(·EKEV· + ·EKEACBVE· kits).
- (8) Mix of ·AHU· units and ·VRV DX indoor·.
- (9) If the equivalent piping length between is > ·90·m, size up the main liquid and gas piping.
- (9) Up to ·3· piping branches are possible in case of an AHU with an interlaced heat exchanger.

3D079540F

RYYQ-U
RYMQ-U

VRV4
Heat pump
Piping restrictions ·2/3·

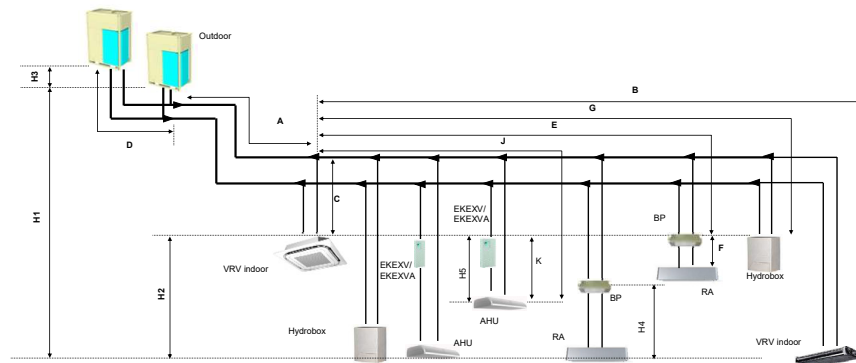

Remark

- (1) Schematic indication
Illustrations may differ from the actual appearance of the unit.
- (2) This is only to illustrate piping length limitations.
Combination of indoor unit types is not allowed.
Refer to combination table ·3D079543· for details about the allowed combinations.

	Allowed piping length		Maximum height difference	
	·BP· to ·RA· (F)	·EKEV/EKEV· to ·AHU· (K)	·BP· to ·RA· (H4)	·EKEV/EKEV· to ·AHU· (H5)
-RA- connection	2~15m	-	5m	-
-AHU- connection	Pair	≤5m	-	5m
	Multi ⁽¹⁾	≤5m	-	5m
	Mix ⁽²⁾	≤5m	-	5m

Remark

- (1) Multiple air handling units (AHU)(·EKEV· + ·EKEQ· kits) or (AHU)(·EKEV· + ·EKEACBVE· kits).
- (2) Mix of ·AHU· units and ·VRV DX indoor·.

3D079540F

12 Installation

12 - 3 Refrigerant Pipe Selection

RYYQ-U

RYMQ-U

VRV4

Heat pump

Piping restrictions :3/3:

System pattern Allowed connection ratio (CR)	Total		Allowed capacity			
	Capacity	Indoor unit quantity (VRV, RA, AHU, Hydrobox)	VRV DX indoor unit	RA DX indoor unit	Hydrobox unit	Air handling unit (AHU)
Other combinations are not allowed.						
VRV DX indoor units only	50~130%	Max.64	50~130%	-	-	-
VRV DX indoor unit + RA DX	80~130%	Max.32 ⁽¹⁾	0~130%	0~130%	-	-
RA DX indoor unit	80~130%	Max.32 ⁽¹⁾	-	80~130%	-	-
VRV DX indoor unit + LT hydrobox	50~130%	Max.32 ⁽²⁾	50~130%	-	0~80%	-
VRV DX indoor unit + AHU([EKEQV+ EKEQ*]/[EKEQV+EKEACBVE]) Mix	50~110% ⁽³⁾	Max.64 ⁽²⁾	50~110%	-	-	0~60%
AHU only (-EKEQ*+ EKEQV) Pair + multi	90~110% ⁽³⁾	Max.64 ^{(2) (6)}	-	-	-	90~110% ⁽³⁾
AHU only (-EKEACBVE+ EKEQV-A) Pair + multi	65/75 ⁽³⁾ ~110% ⁽³⁾	Max.64 ^{(2) (6)}	-	-	-	65/75 ⁽³⁾ ~110% ⁽³⁾

Remark


- (1) There is no restriction on the number of connectable BP boxes.
 - (2) For connection with AHU:
-EKEQV/EKEQV-A kits are also considered indoor units.
 - (3) Restrictions regarding the air handling unit capacity
 - (4) Pair AHU = system with 1 air handling unit connected to one outdoor unit system
Multi AHU = system with multiple air handling units connected to one outdoor unit system
Mixed AHU = mix of AHU units and VRV DX indoor units connected to one outdoor system
 - (5) -75% ~ 110%: default situation
-65% ~ 75%: Allowed if stricter AHU volume limitations are valid.
Refer to the databook of EKEACBVE for details.
 - (6) Number of AHUs that can be connected in case of pair or multi layout depends on the control types:
→ X-control is possible (up to 3 [-EKEQV+EKEQFA*] or -EKEQV-A + EKEACBVE boxes) can be connected to one outdoor unit (system).
→ Y-control is possible (up to 3 [-EKEQV+EKEQFA*] or -EKEQV-A + EKEACBVE boxes) can be connected to one outdoor unit (system).
→ W-control is possible (up to 3 [-EKEQV+EKEQFA*] or -EKEQV-A + EKEACBVE boxes) can be connected to one outdoor unit (system).
→ Z-control is possible (the allowed number of [-EKEQV-A + EKEACBVE boxes] is determined by the connection ratio and the capacity of the outdoor unit.
→ Z-control is possible (the allowed number of [-EKEQV + EKEQMA boxes] is determined by the connection ratio and the capacity of the outdoor unit.
- About ventilation applications**
- I. FXMQ_MF units are considered air handling units, following air handling unit limitations.
Maximum connection ratio when combined with VRV DX indoor units: <30%.
Maximum connection ratio when only air handling units are connected: <100%.
For information on the operation range, refer to the documentation of the FXMQ_MF unit.
 - II. Biddle air curtains are considered air handling units, following air handling unit limitations:
For information on the operation range, refer to the documentation of the Biddle unit.
 - III. [-EKEQV + EKEQ]/[EKEQV-A + EKEACBVE] units combined with an air handling unit are considered air handling units, following air p
For information on the operation range, refer to the documentation of the -EKEQV-EKEQ/[EKEQV-A-EKEACBVE] unit.
 - IV. VKM units are considered to be regular VRV DX indoor units.
For information on the operation range, refer to the documentation of the VKM unit.
 - V. Because there is no refrigerant connection with the outdoor unit (only communication F1/F2), -VAM units do not have connection limitations.
However, since there is communication via F1/F2, count them as regular indoor unit when calculating the maximum allowed number of connectable indoor units.

3D079540F

13 Operation range

13 - 1 Operation Range

RXYQQ-U
RXYQ-U
RYYQ-U
RYMQ-U

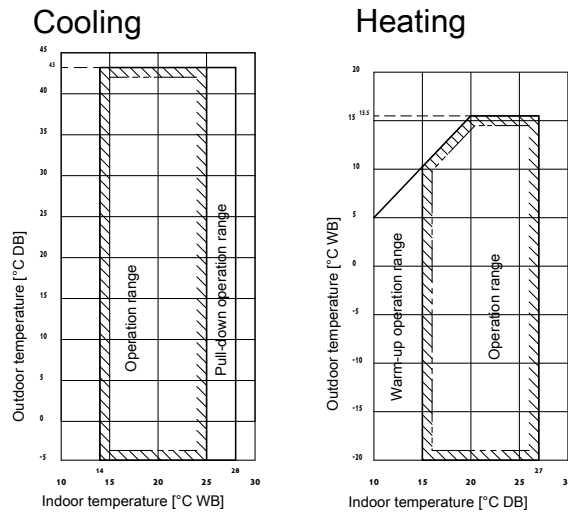

Notes

1. These figures assume the following operation conditions

Indoor and outdoor units

Equivalent piping length: 5m

Level difference: 0m

2. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).

3. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.

4. Operation range is valid in case direct expansion indoor units are used.

3D118465

14 Appropriate Indoors

14 - 1 Appropriate Indoors

RYYQ-U

RYMQ-U

Recommended indoor units for -RXYQ*U* / RYYQ*U* / RYM*U*- outdoor units

~ HP	8	10	12	14	16	18	20
	4xFXMQ50	4xFXMQ63	6xFXMQ50	1xFXMQ50 5xFXMQ63	4xFXMQ63 2xFXMQ80	3xFXMQ50 5xFXMQ63	2xFXMQ50 6xFXMQ63

For multi outdoor units -> 16HP, the recommended amount of indoor units is the sum of the indoor units defined for a single outdoor unit.
For details about the allowed combinations, see the engineering databook.

Appropriate indoor units for -RXYQ*U* / RYYQ*U* / RYM*U*- outdoor units

Covered by -ENER LOT21-

FXFQ20-25-32-40-50-63-80-100-125
FXZQ15-20-25-32-40-50
FXCQ20-25-32-40-50-63-80-125
FXKQ20-25-32-40-50-63
FXDQ15-20-25-32-40-50-63
FXSQ15-20-25-32-40-50-63-80-100-125-140
FXMQ50-63-80-100-125-200-250
FXAQ15-20-25-32-40-50-63
FXHQ32-63-100
FXUQ71-100
FXNQ20-25-32-40-50-63
FXLQ20-25-32-40-50-63


Covered by -ENER LOT10-

FTXJ20-25-35-42-50
FTXA20-25-35-42-50
FLXS25-35-50-60
FVXG25-35-50
FTXM20-25-35-42-50-60-71
CVXM20
FVXM25-35-50

Outside the scope of -ENER LOT21-

EKEV50-63-80-100-125-140-200-250-400-500 + EKEQM / EKEQF
EKEVA 50-63-80-100-125-140-200-250-300+350+400+450+500 + EKEACBVE
HXY080-125
VKM50-80-100
CYVS100*80, CYVS150*80, CYVS200*100, CYVS250*140
CYAS100*80, CYAS150*80, CYAS200*100, CYAS250*140
CYVM100*80, CYVM150*80, CYVM200*100, CYVM250*140
CYAM100*80, CYAM150*80, CYAM200*100, CYAM250*140
CYVL100*125, CYVL150*200, CYVL200*250, CYVL250*250
CYAL100*125, CYAL150*200, CYAL200*250, CYAL250*250
EKVDX32-50-80-100 + VAMJ8

3D118461G



EEDEN25

06/2025



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.